


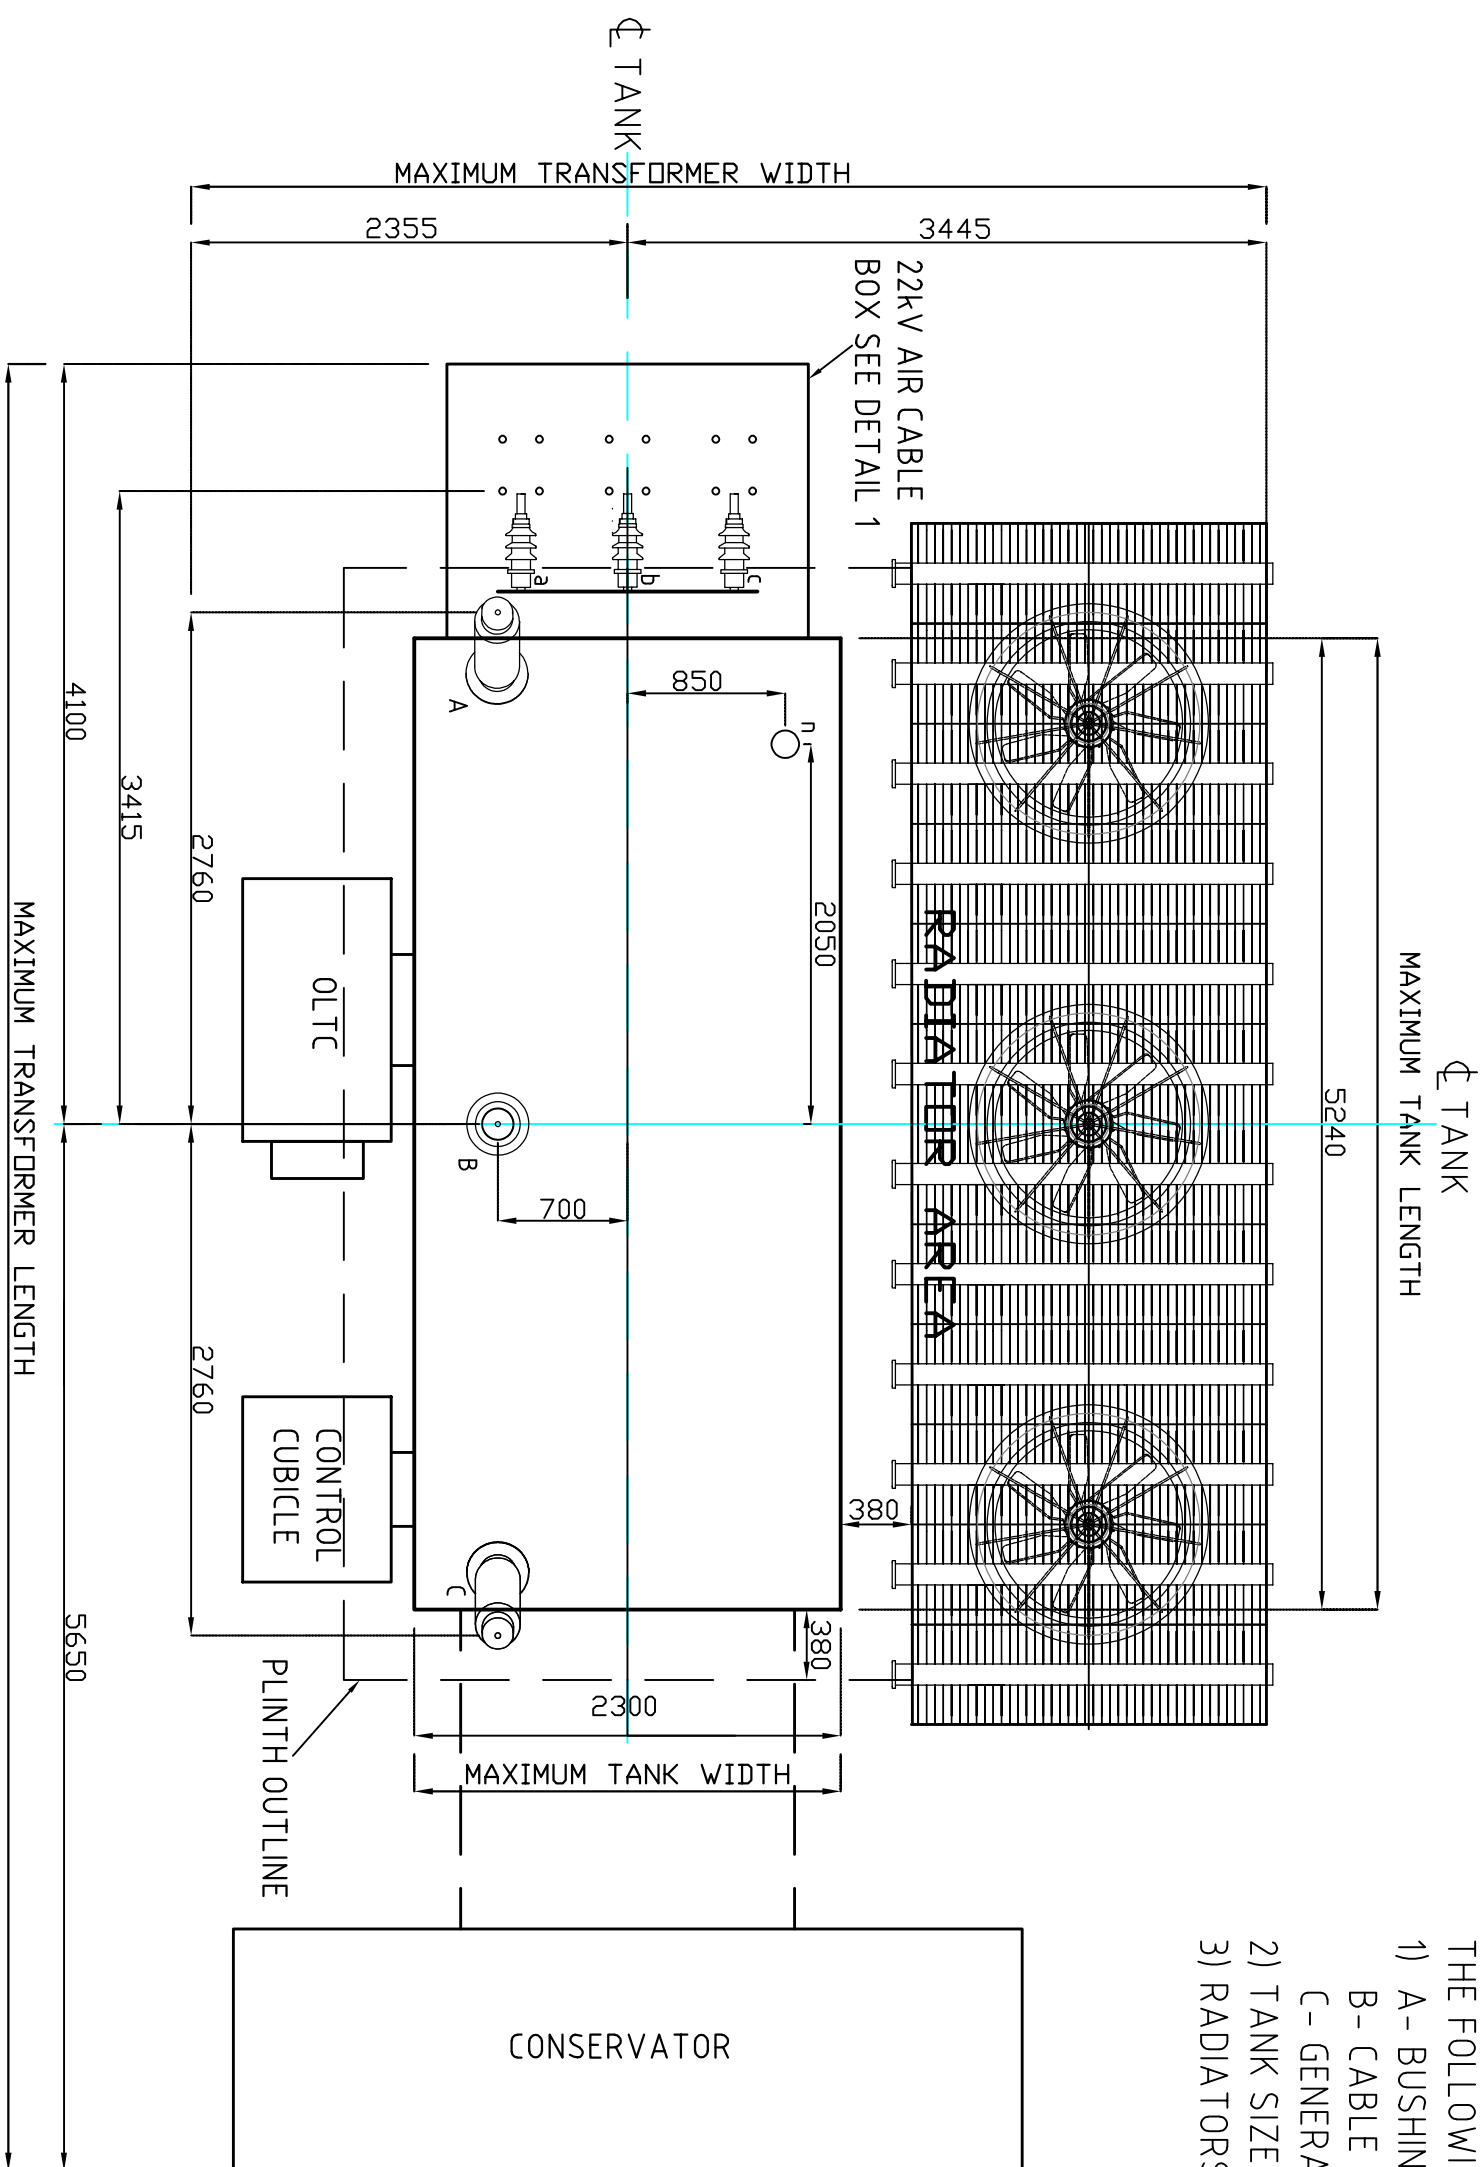

NOTES:

THE FOLLOWING CRITERIA ARE MANDATORY:


1) A - BUSHING LOCATIONS

B- CABLE LOCATIONS AND QUANTITY

C - GENERAL LOCATIONS OF CONTROL CUBICLE AND OLT/C

2) TANK SIZE

3) RADIATORS TO REMAIN WITHIN RADIATOR AREA

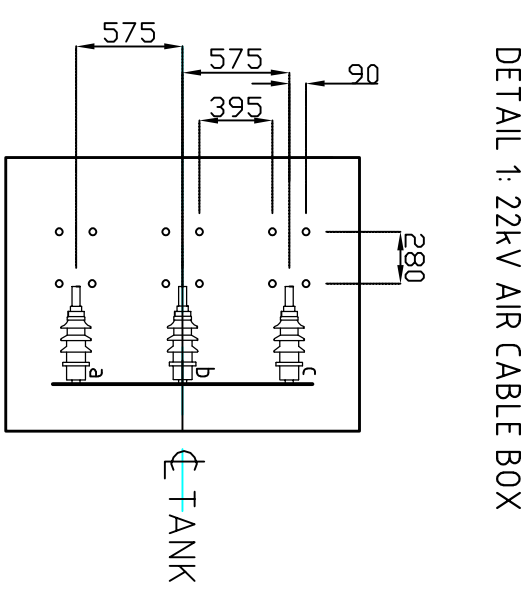

AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	

		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, leased or used without the written consent of Endeavour Energy.	
 ORIGINAL SCALE		APPROVED P. RAMSAY	
DRAWN	D.BAJIC		
DATE	7-03-25		
CH'D			



TENDER BASE DESIGN TRANSFORMER 132/22kV 45MVA HV BUSHING & LV CABLE ATTACHED RADIATOR GENERAL ARRANGEMENT

A2		Rev.	
536524		A	
SHEET No 1 OF 1		SHEETS	