


1	2	3	4	5	6
AMENDMENTS	NOTE		ITEM	QTY	DESCRIPTION
A	ORIGINAL		-	-	
ISSUE					REMARKS

- 1) MOUNTING FRAME TO BE SUITABLE TO WITHSTAND A RESULTANT LOAD OF 10KN IN ANY ANGLE.
- 2) DUE TO HISTORICAL REASONS THIS BOLT PATTERN COULD BE 190, 200 OR 300 MM AND SHOULD BE SUITABLE FOR ALL MOUNTINGS.

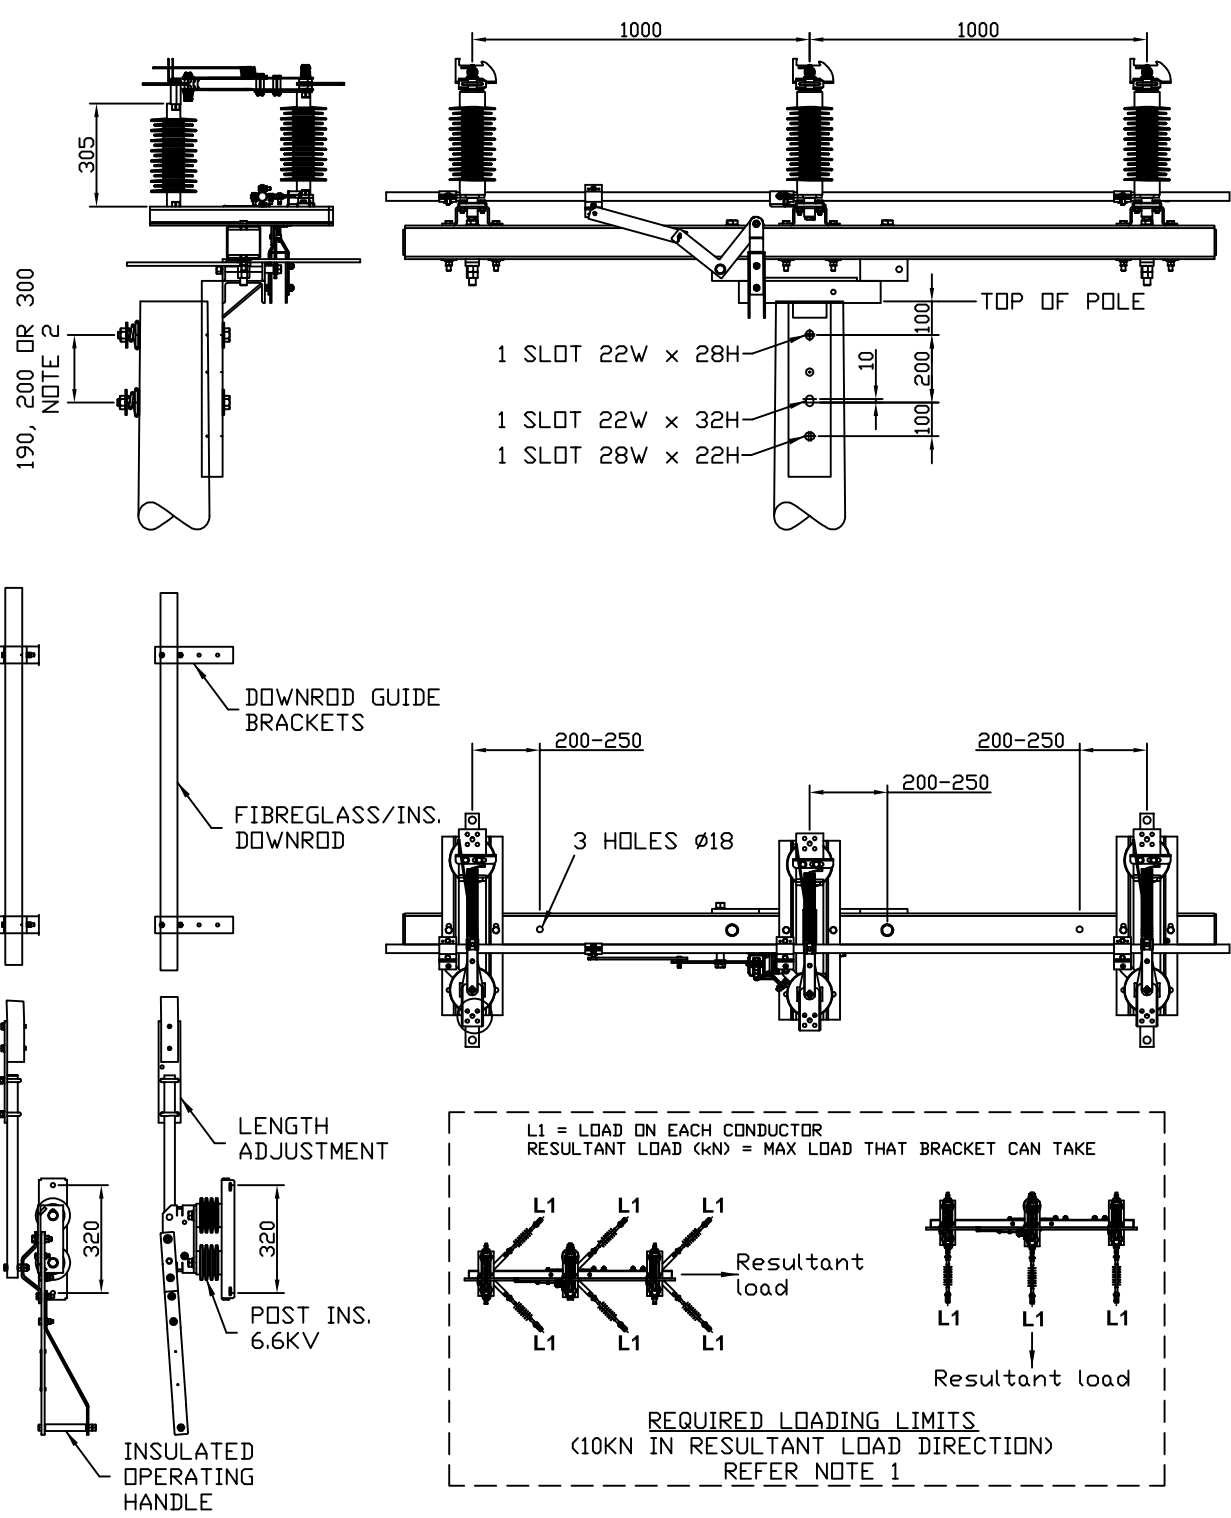

		REFERENCE DRAWINGS DO NOT SCALE DIMENSIONS IN MILLIMETRES	
APPROVED G. Ford		AUTHORIZED W. Isley	
DRAWN G. Ford	DATE 22/04/09	MANAGER ASSET ENGINEERING 22/04/09	SHEET No 1 OF 1 SHEETS
CHD G. Ford	REF F003F	AIR BREAK SWITCH CRITICAL DIMENSIONS AND LOADING REQUIREMENTS	