


AMENDMENTS	
A	ORIGINAL ISSUE
B	MINOR CHANGES
C	MINOR CHANGES TO DRAWING LAYOUT.
BB	12/04/19

NOTES:

1. ALL STEEL PLATES TO CONFORM TO AS 3678 GRADE 250 U.O.N.
2. ALL STEEL BARS AND SECTIONS TO CONFORM TO AS 3679 GRADE 250 U.O.N.
3. ALL FILLET WELDS TO BE 6mm CONTINUOUS U.O.N. AND ARE TO CONFORM TO AS 1554, PART 1, CATEGORY G.P. U.O.N.
4. ALL SHARP EDGES AND BURRS TO BE REMOVED.
5. ALL TAPER LOCK JOINT LENGTHS ARE NOMINAL U.O.N.
6. ALL STEEL TO BE FULLY HOT DIP GALVANIZED AFTER FABRICATION IN ACCORDANCE WITH AS/NZ4680.
7. SECTIONS TO BE STAGGERED DURING ASSEMBLY TO PREVENT SEAM WELDS LINING UP.

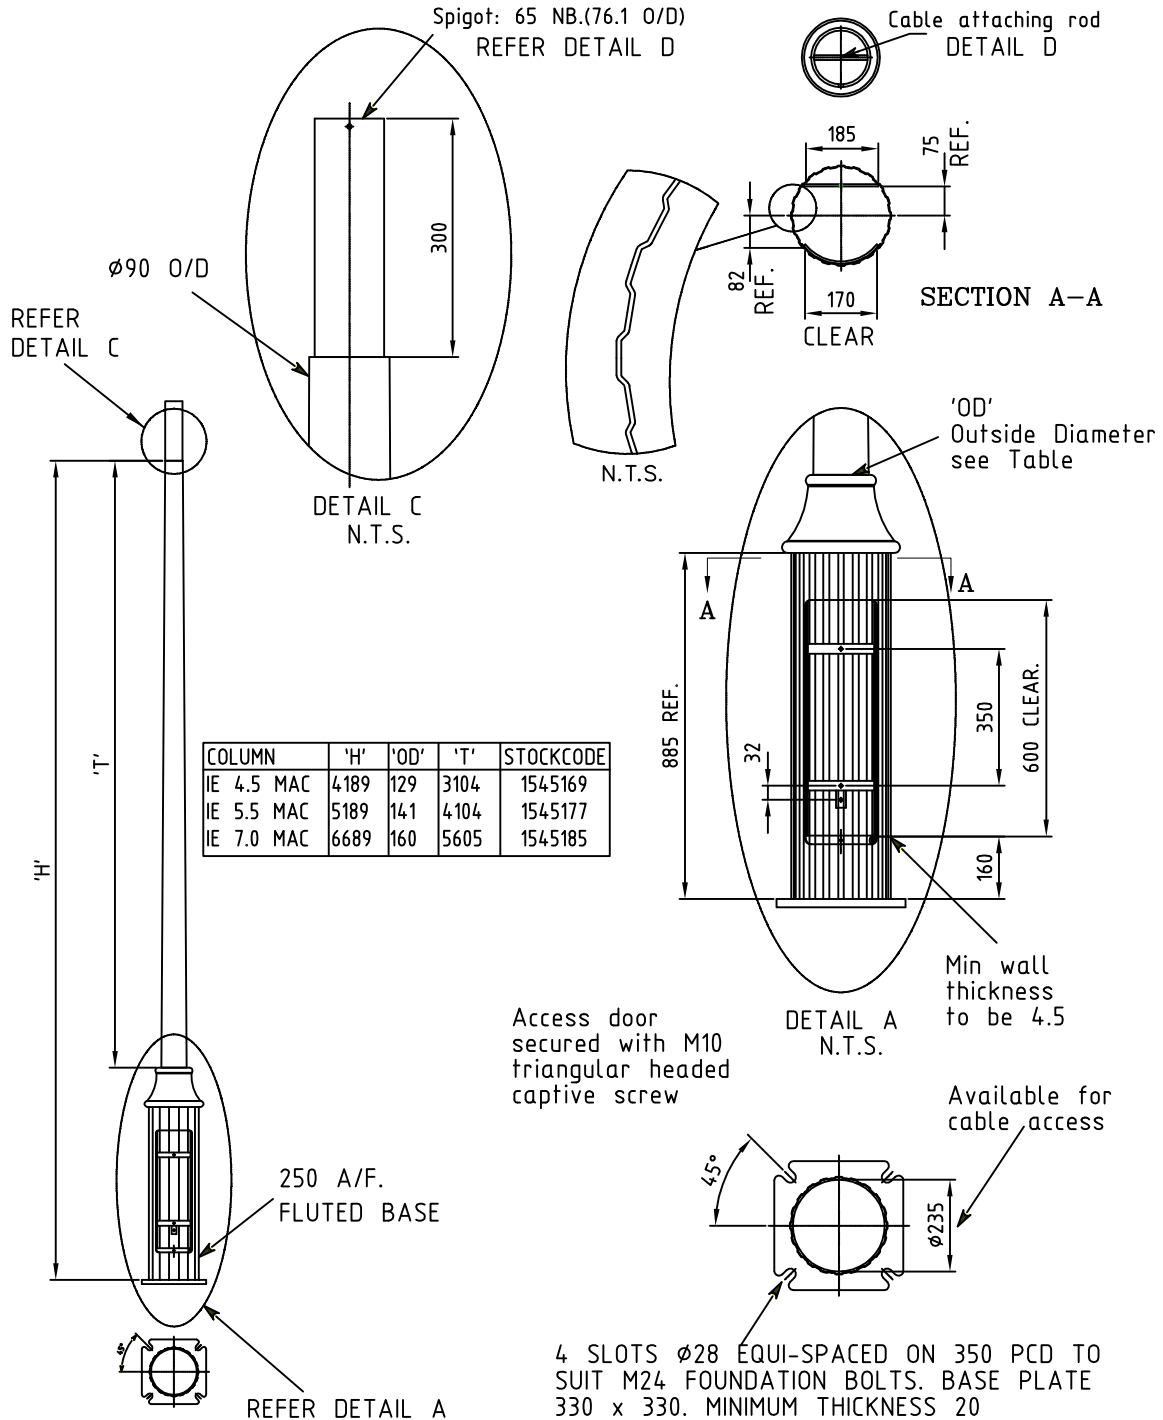

	©This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.
ORIGINAL SCALE	APPROVED BH
DRAWN PW	-
DATE 11.4.01	-
BYD PA	-



Endeavour Energy

MACARTHUR COLUMN
GENERAL DETAIL

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

REFERENCE DRAWINGS
AUTHORISED
W. Isley

MANAGER ASSET ENGINEERING 11.4.11
A4 262715 C
SHEET No 1 OF 1 SHEETS