


AMENDMENTS	
A	ORIGINAL ISSUE
B	DRN VOTTA CHD B.H. DATE 17.3.2009 UR No
Revised and title modified.	
C	DRN B.H. CHD D.H. DATE 12.4.2010 UR No
Revised and frame modified.	
M.A.E. J.P.	

NOTES:

1. ALL STEEL PIPES TO CONFORM TO AS 1163 GRADE 250 U.N.O.
2. ALL WELDS TO BE CONTINUOUS FILLET AND CONFORM WITH AS 1554.
3. ALL SHARP EDGES AND BURRS TO BE REMOVED.
4. ALL STEEL TO BE FULLY HOT DIP GALVANIZED AFTER FABRICATION IN ACCORDANCE WITH AS4680.
5. TO BE SUPPLIED WITH M6x60 HEX HEAD SCREWS AND M6 NYLOCK NUT WITH PLAIN AND SPRING WASHERS.

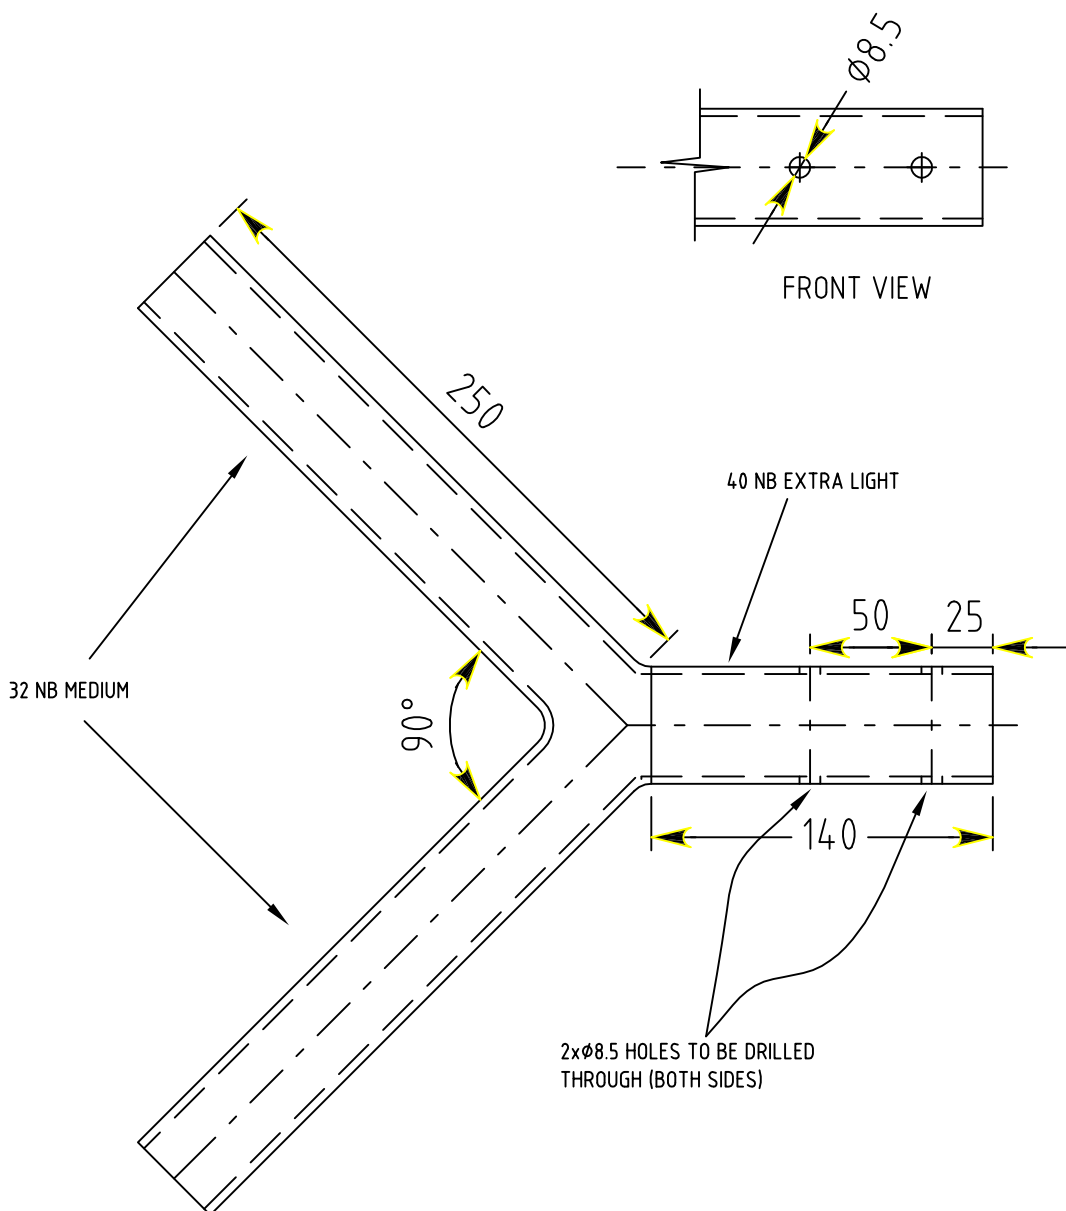

ORIGINAL SCALE	APPROVED
DRAWN B.J.H.	S. TURKI
DATE 2.3.04	
CHD B.H.	



Endeavour Energy

LUMINAIRE
90° "Y" SPIGOT ADAPTOR
GENERAL DETAIL

REFERENCE DRAWINGS	
DO NOT SCALE DIMENSIONS IN MILLIMETRES	AUTHORISED W. ISLEY
MANAGER DISTRIBUTION ENGINEERING	17.4.2009
A4	287051
SHEET No 1 OF 1 SHEETS	