| AMENDMENTS | | |
|---|---|---|
| A | ORIGINAL ISSUE | |
| B | MINOR CHANGES TO DRAWING LAYOUT. | BB 12/04/18 |
| C | MINOR CHANGES TO DRAWING TITLE. | BB 9/11/18 |

NOTES:

1. ALL STEEL PLATES TO CONFORM TO AS3678 GRADE 250 U.O.N.
2. ALL STEEL BARS AND SECTIONS TO CONFORM TO AS3679 GRADE 250 U.O.N.
3. ALL FILLET WELDS TO BE 6mm CONTINUOUS U.O.N. AND ARE TO CONFORM TO AS1554, PART 1, CATEGORY G.P. U.O.N.
4. ALL SHARP EDGES AND BURRS TO BE REMOVED.
5. ALL TAPER LOCK JOINT LENGTHS ARE NOMINAL U.O.N.
6. ALL STEEL TO BE FULLY HOT DIP GALVANIZED AFTER FABRICATION IN ACCORDANCE WITH AS1650.
7. SECTIONS TO BE STAGGERED DURING ASSEMBLY TO PREVENT SEAM WELDS LINING UP.




VIEW A




DETAIL B.
NTS.




4 slots ø28 equi-spaced on 350 PCD.
To suit M24 foundation bolts.
Base plate 330x330. 20mm thick min.

VIEW IN DIRECTION OF ARROW 'A'.




SECTION A-A.
NTS.

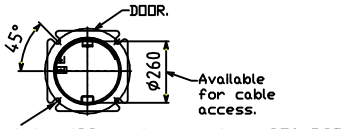


IE-SL7IA

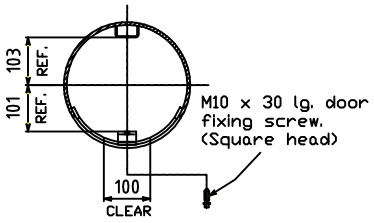


IE-SL8.5IA

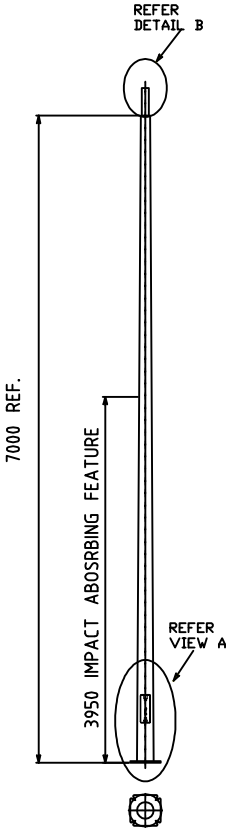


IE-SL10IA

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, issued or used without the written consent of Endeavour Energy.
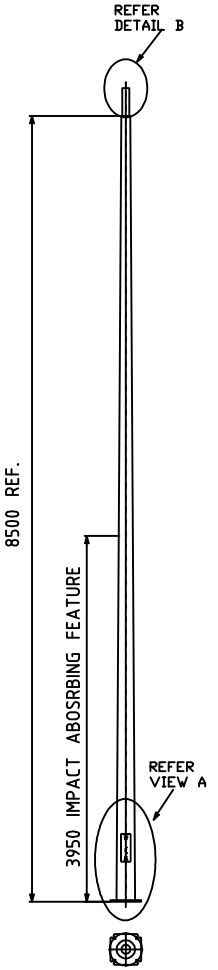
| | | | |
|---|---|---|---|
| ORIGINAL SCALE | | APPROVED | W. ISLEY |
| DRAWN | | | |
| DATE | 7.6.04 | | |
| CH'D | CJJ | | |

Endeavour Energy

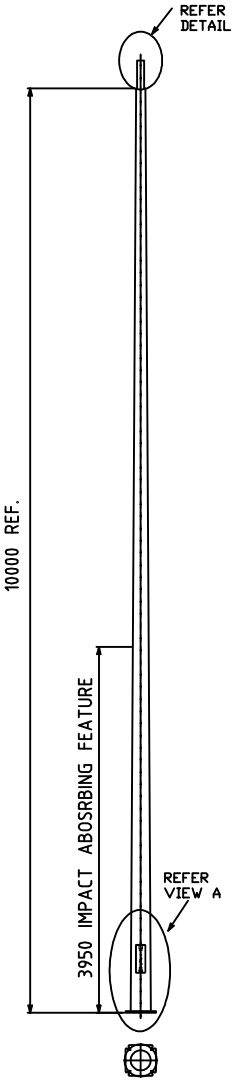DO NOT SCALE
DIMENSIONS IN MILLIMETRES

REFERENCE DRAWINGS

AUTHORISED
W. ISLEY
MANAGER DISTRIBUTION ENGINEERING 7.6.04

ROUND IMPACT ABSORBING COLUMN
GENERAL DETAIL

A4 288197 C

SHEET No 1 OF 1 SHEETS