


AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	WTE1406

NOTES

- POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL.
- VISIBLE LOCATION 95mm² INSULATED EARTH ABOVE INSULATED COVER.
- FIT POLE INSULATING COVER OVER CABLE GUARD & FIX STAINLESS STEEL STRAP. IF REQUIRED IN EARTHING REPORT.
- CHECK CABLE SCREEN EARTHING REQUIREMENT.
- IF AREA SURROUNDING POLE IS EXCAVATED FOR INSTALLATION OF CABLE:
 - POLE MAY REQUIRE TEMPORARY SUPPORT/STABILISATION
 - BACKFILL TO BE COMPACTED

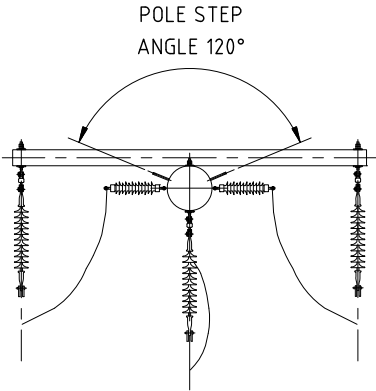



ITEM	PART	DRG	DESCRIPTION	QTY
1	-	280236	POLE PRESTRESSED CONCETE	1
2	1561802	370399	POLE STEP 16mm FOR CONCRETE/STEEL	A/R
3	SC14819	052796	CROSSARM TYPE C3- STEEL SHS (152 X 152 X 3000 LG)	1
4	1018620	079023	BRACE CROSSARM	2
5	ALR002	398038	INSULATOR LONG ROD ASSEMBLY	3
6	-	-	OHEW ASSEMBLY TYPE AS PER PROJECT.	1
7	1560911	259304	CABLE COVER 3300mm LONG	1
8	1550862	-	CABLE CLAMP 50-200mm DIAMETER	18
9	1560937	077162	BRACKET FOR 33kV SURGE DIVERTER	3
10	1560929	078931	BRACKET CABLE SUPPORT	3
11	1550516	-	SURGE DIVERTER 33kV	3
12	SEE TABLE 1	-	33kV CABLE TERMINATION XLPE OUT DOOR	1
13	SEE TABLE 2	-	LUG CABLE	3
14	SEE TABLE	399844	LUG CONDUCTOR TO SUIT CONDUCTOR	3
15	SS11491	-	CLAMP CABLE TO SUIT 84mm DIA CABLE	3
16a	AEC-A	051125	EARTH CONNECTION AEC-A	1
16b	AEG-B	051125	EARTH CONNECTION AEC-B	2
16e	AEG-E	051125	EARTH CONNECTION AEC-E	1
17a	ACP007	240600	M20 BOLT ASSEMBLY FOR CROSSARM	1
17b	ACP009	240600	M16 BOLT ASSEMBLY FOR CROSSARM	2
17c	ACP005	240600	M20 EYEBOLT ASSEMBLY FOR POLE	1
17d	ACP006	240600	M20 EYEBOLT ASSEMBLY FOR CROSSARM	2
17e	ACP010	240600	M16 BOLT ASSEMBLY FOR POLE	1
18	1550508	-	CABLE SCREEN SURGE DIVERTER REFER NOTE 4	3
19	1562909	380808	POLE COVER INSULATED- SEE NOTE 3	4
20	SB16973	-	19mm STAINLESS STEEL STRAP- 30m COIL	A/R
21	1103183	-	BOLT STEEL GALV M12 X 40 LG	12
22	-	-	TAPER WASHER M12	A/R

TABLE 1

CABLE	STOCK NUMBER
630mm 33kV CABLE TERMINATION	1550409
800mm 132kV CABLE TERMINATION	1550409
1200mm 132kV CABLE TERMINATION	1550425

TABLE 2

CABLE	STOCK NUMBER
630mm 33kV CABLE LUG	1554443
800mm 132kV CABLE LUG	1500370
1200mm 132kV CABLE LUG	1519669

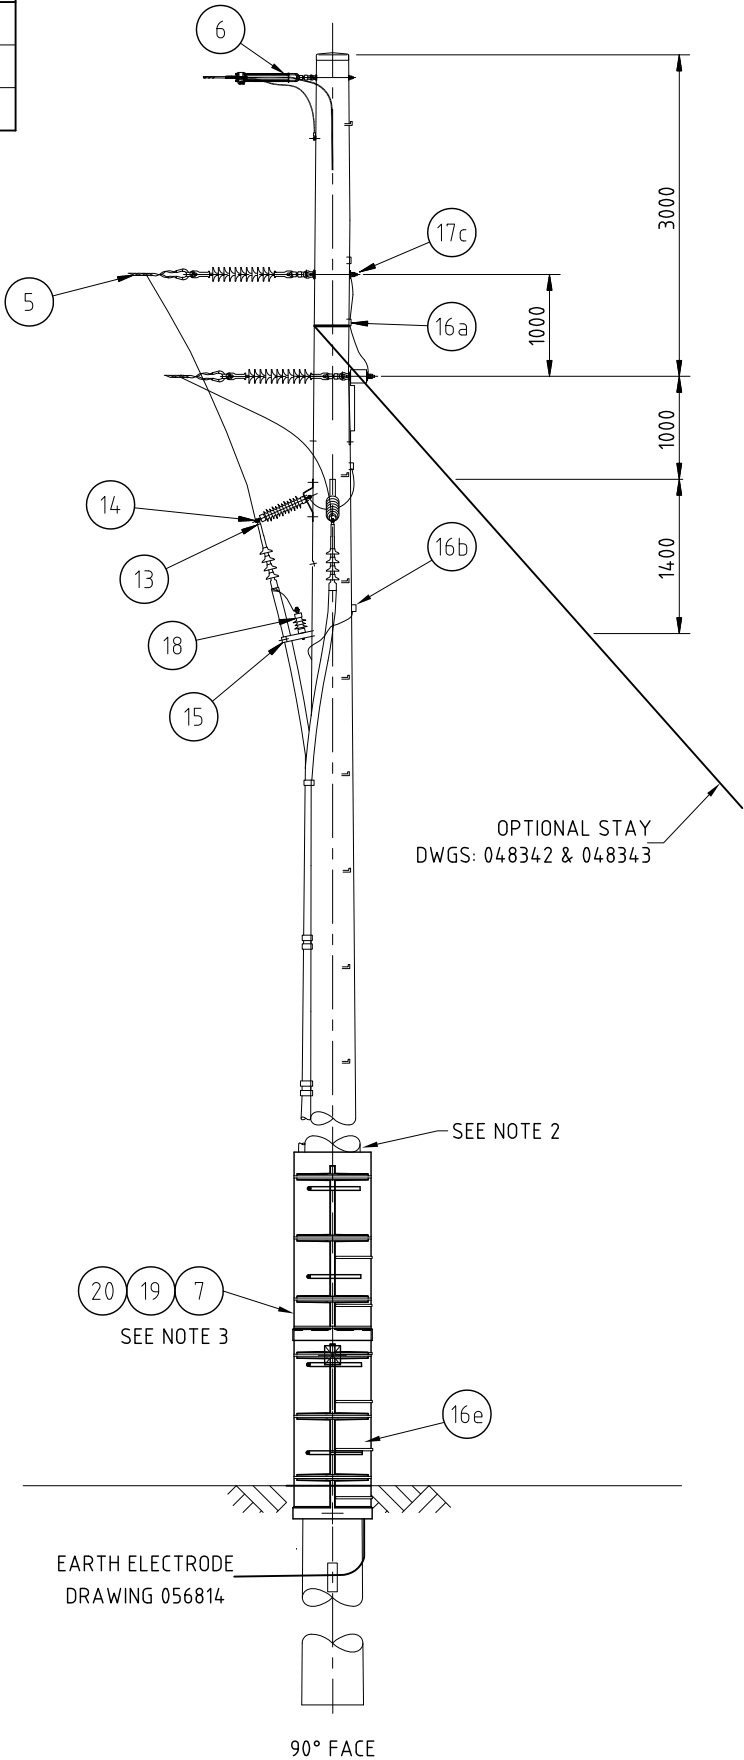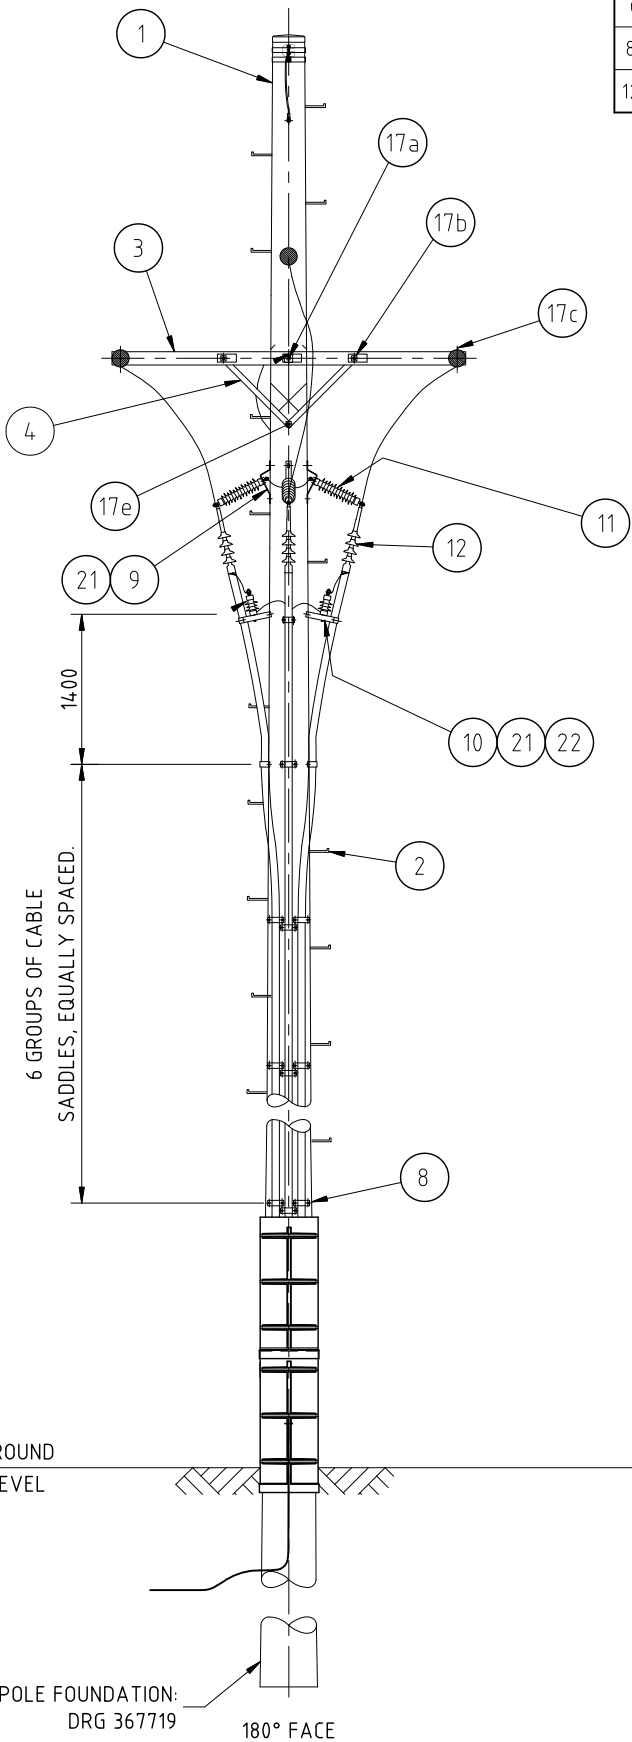

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

ORIGINAL SCALE NTS

APPROVED S.F.Williams

DRAWN CP

DATE 5/09/2014

CH'D J.B./R.L.

DO NOT SCALE DIMENSIONS IN MILLIMETRES

REFERENCE DRAWINGS

AUTHORISED D.Mate

NETWORK MAINS MANAGER

31.10.14

Rev.

OVERHEAD TRANSMISSION 33kV CONSTRUCTION No. 50C UG/OH DELTA TERMINATION

A2P

398007

A

SHEET No 1 OF 1 SHEETS