
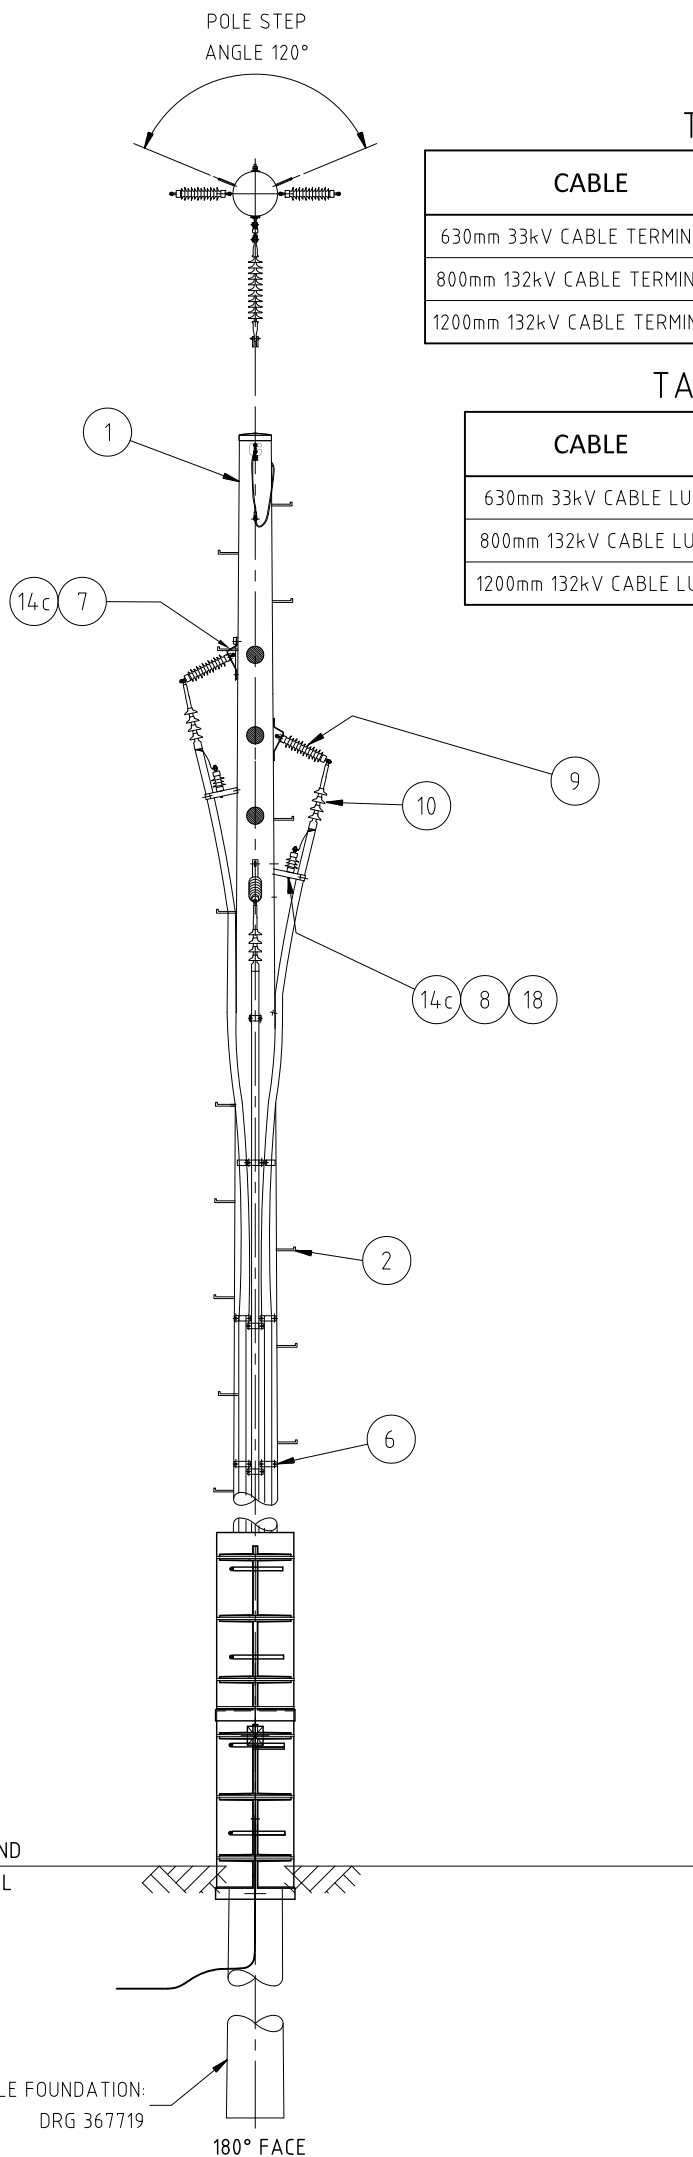



	2	3	
NOTES			
1. POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL. 2. VISIBLE LOCATION 95mm² INSULATED EARTH ABOVE INSULATED COVER. 3. FIT POLE INSULATING COVER OVER CABLE GARD & FIX WITH S/STEEL STRAP. IF REQUIRED IN EARTHING REPORT. 4. CHECK CABLE SCREEN EARTHING REQUIREMENT. 5. IF AREA SURROUNDING POLE IS EXCAVATED FOR INSTALLATION OF CABLE: -POLE MAY REQUIRE TEMPORARY SUPPORT/STABILISATION -BACKFILL TO BE COMPACTED			

Technical drawing of a vertical earth electrode assembly. The drawing shows a vertical rod with various components labeled with circled numbers: 3 (top terminal), 4 (top terminal), 11 (terminal), 12 (terminal), 13 (terminal), 14a (rod), 14b (rod), 16 (rod), 17 (rod), and 5 (rod). Dimensions are indicated on the right: 2000, 1800, 1800, 900, and 1350. A note "SEE NOTE 2" points to the rod. A note "REFER NOTE 3" points to the rod. The bottom section is labeled "EARTH ELECTRODE ASSEMBLY" and "DRAWING 048340". The bottom of the rod is labeled "90° FACE".

CABLE	STOCK NUMBER
630mm 33kV CABLE LUG	1554443
800mm 132kV CABLE LUG	1500370
1200mm 132kV CABLE LUG	1519669



		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.		 Endeavour Energy								
 ORIGINAL SCALE NIL		APPROVED S.F.Williams		DO NOT SCALE DIMENSIONS IN MILLIMETRES		REFERENCE DRAWINGS AUTHORISED D.Mate						
DRAWN	CP			OVERHEAD TRANSMISSION 33kV CONSTRUCTION No. 50VT UG/OH VERTICAL TERMINATION				NETWORK MAINS MANAGER		31.10.14		
DATE	5/09/2014							A2P	398032	Rev.		A
CH'D	J.B./R.L.									SHEET No 1 OF 1 SHEETS		