
AMENDMENTS	
A	ORIGINAL ISSUE
J R No.	930208
B	DR'N C.R.T. CH'D C.R.T. DATE 07-2-96 JR No 930208
BCC WAS BBCC.	
SEO	C.H.B.
C	DR'N RJH CH'D G.J.B. DATE 27-3-01 JR No NA
ADSS SYSTEM & NOTE 2 ADDED.	
DSM	G.J.B.
D	DR'N KT CH'D BC DATE 14.01.10 JOB No
DA	Bruce Coxon
TELSTRA PHONE CABLE & NOTE 3 ADDED, NOTE 2 REVISED.	
E	DR'N GSF CH'D SD DATE 11-8-10 JR No NA
ADSS DIM MOD. & NOTE 2 REMOVED.	
DSM	G.J.B.
F	DR'N J.P. CH'D M.A.S. DATE 17-02-14 JR No NA
SUPPORT BKT ADDED TO X-ARM.	
DSM	M.A.S.
G	DR'N SM CH'D BH DATE 24-01-18 JR No NA
MOVED LV AND SL TO SHEET 2. ADDED CONDUCTIVE COMM CLEARANCE. UPDATED NOTES.	
MAM	BH

NOTES

1. REFER TO MCI0002 FOR FURTHER REQUIREMENTS
2. FOR JOINT USE POLES WITH HV AND LV CONSTRUCTIONS, THE CLEARANCES TO LV CABLES, AS PER SHEET 2 AND TABLE 3 IN MCI 0002 ARE REQUIRED.

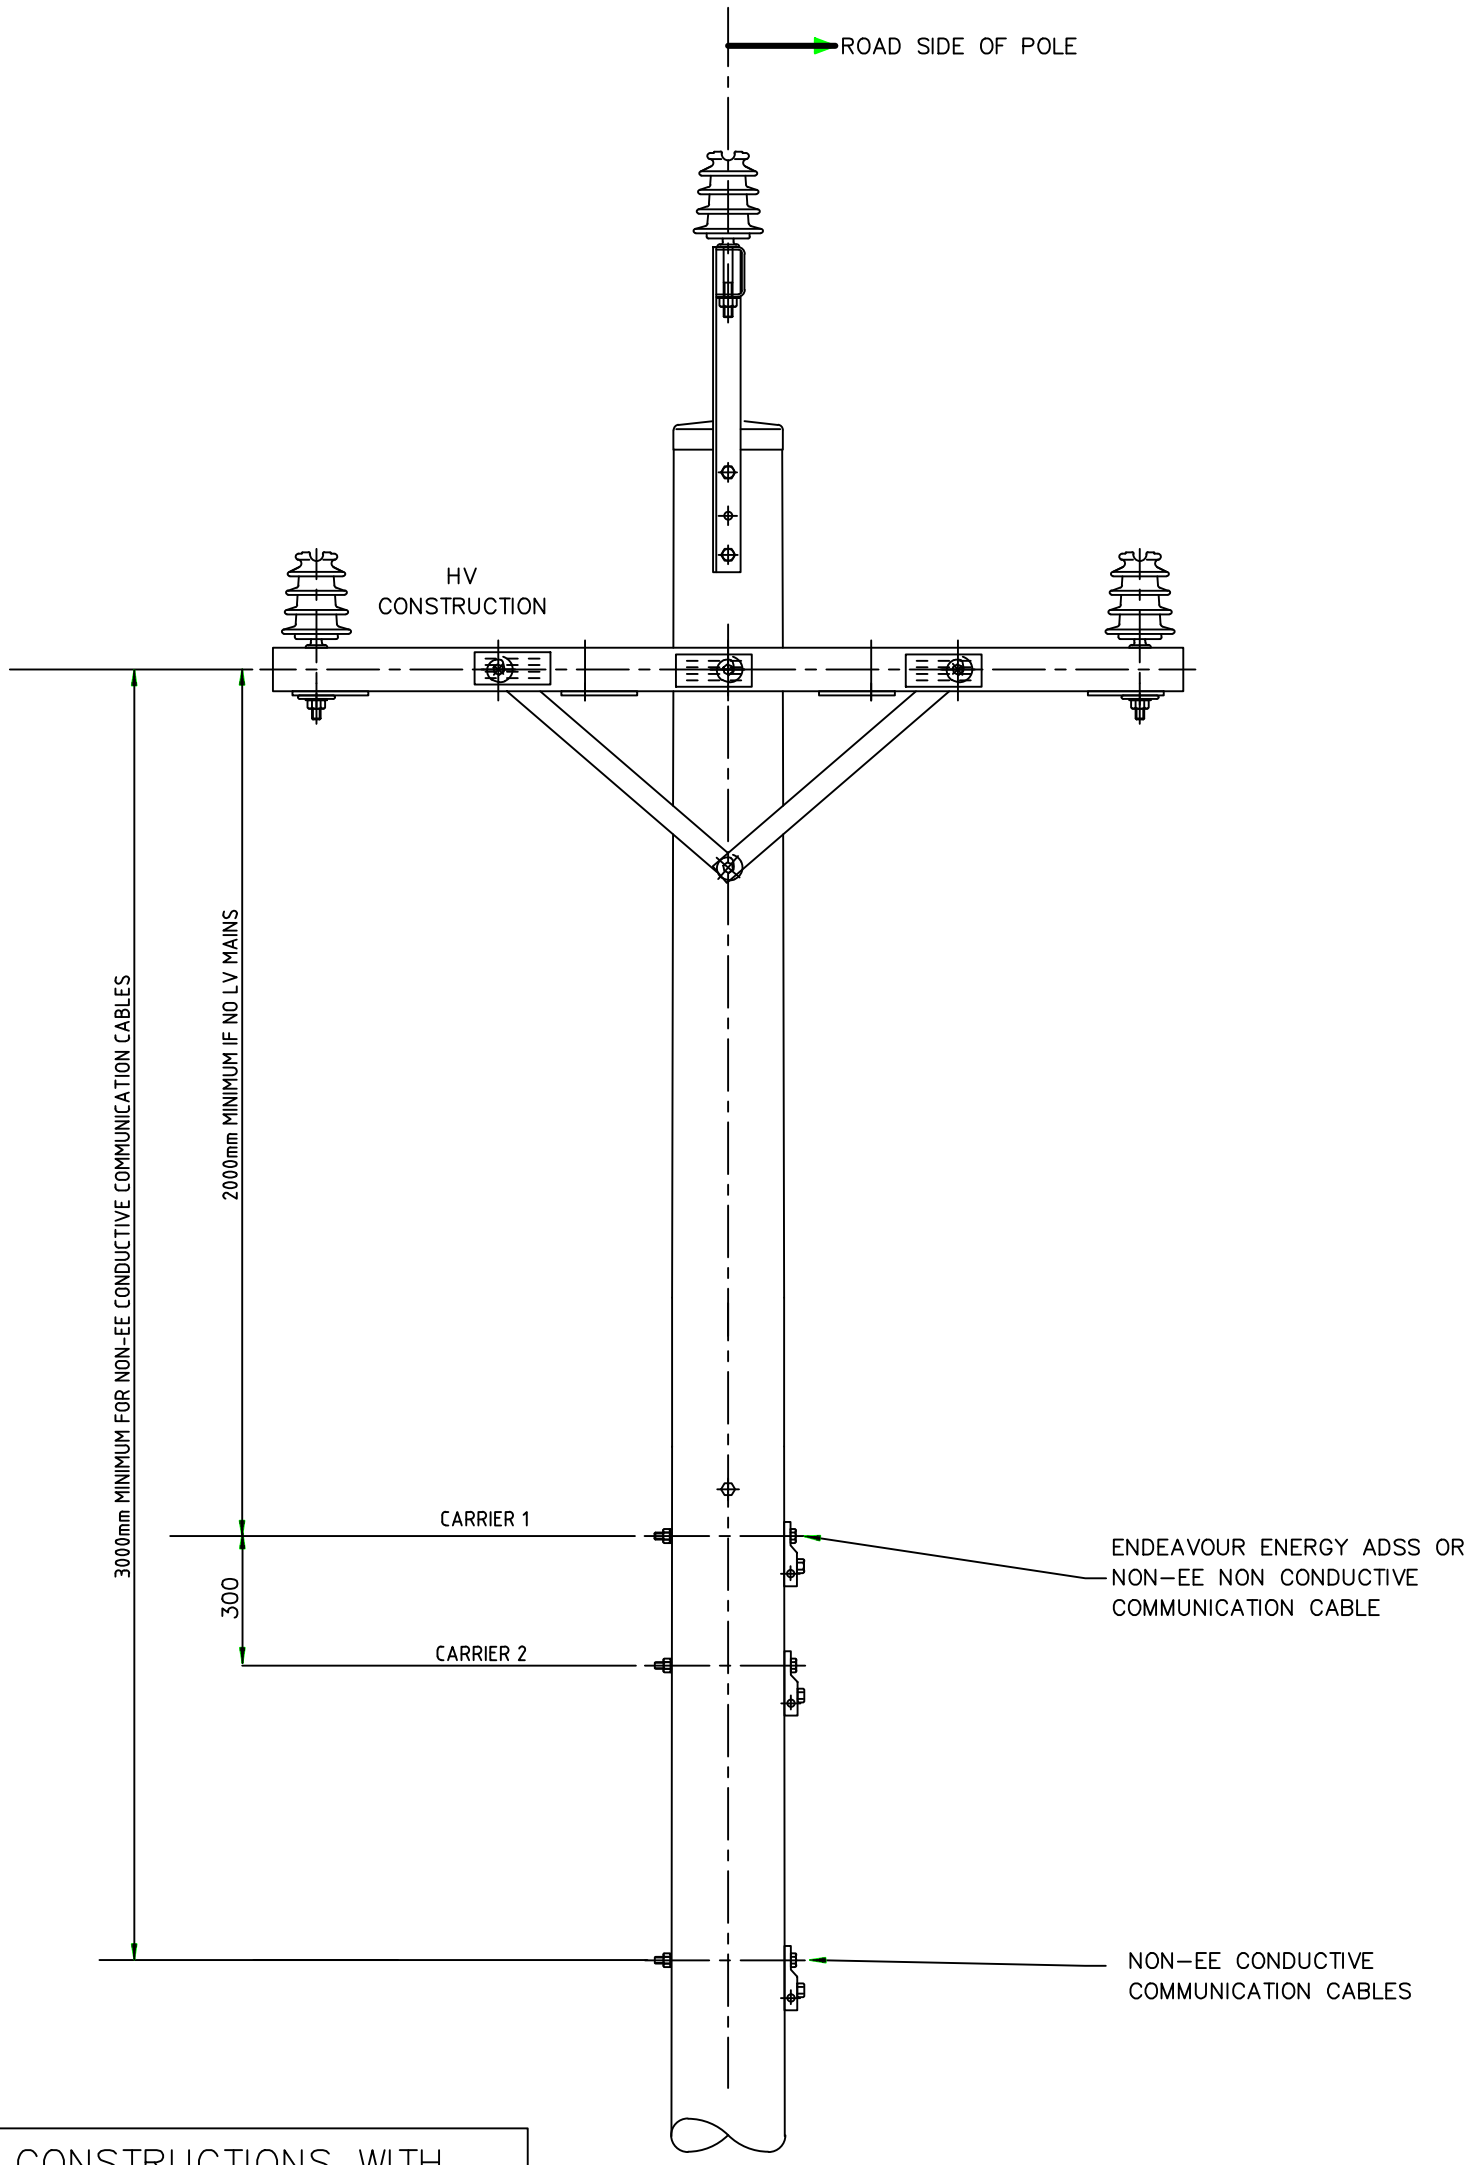

CONSTRUCTIONS WITH BARE HV MAINS ONLY. REFER TO SHEET 2 FOR LV AND SL CLEARANCES

© This drawing and the copyright therin is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

Endeavour Energy

ORIGINAL SCALE 1:12

APPROVED C.BROWN

REFERENCE DRAWINGS

DO NOT SCALE DIMENSIONS IN MILLIMETRES

AUTHORISED W.Isley

MAINS DEVELOPMENT MANAGER 13-02-96

DRAWN	C.R.T.
DATE	17-2-95
CH'D	C.R.T.

COMMUNICATION CABLE CLEARANCES ON POLE WITH BARE MAINS

A4 078518 G

SHEET No 1 OF 2 SHEETS