


AMENDMENTS			
A	ORIGINAL ISSUE		
J R No.			
G	DR'N	SM	
	CH'D	BH	
	DATE	24-01-18	
	JR No	NA	
CREATION OF SHEET 2 AND TO ALIGN VERSION TO SHEET 1			
MAM		BH	

NOTES			
1. REFER TO MCI0002 FOR MORE DETAILS.			
2. TELSTRA TWISTED PAIR PHONE CABLE REFER CLAUSE 5.3.2.3 OF MCI 0002			
3. FOR JOINT USE POLES WITH HV AND LV CONSTRUCTIONS, THE CLEARANCES TO HV CABLES, AS PER SHEET 1 AND TABLE 3 IN MCI 0002 ARE REQUIRED.			
4. POLE ATTACHMENT CLEARANCE MAY NEED TO BE INCREASED TO ACHIEVE MIDSPAN CLEARANCE REQUIREMENT OF 300MM.			

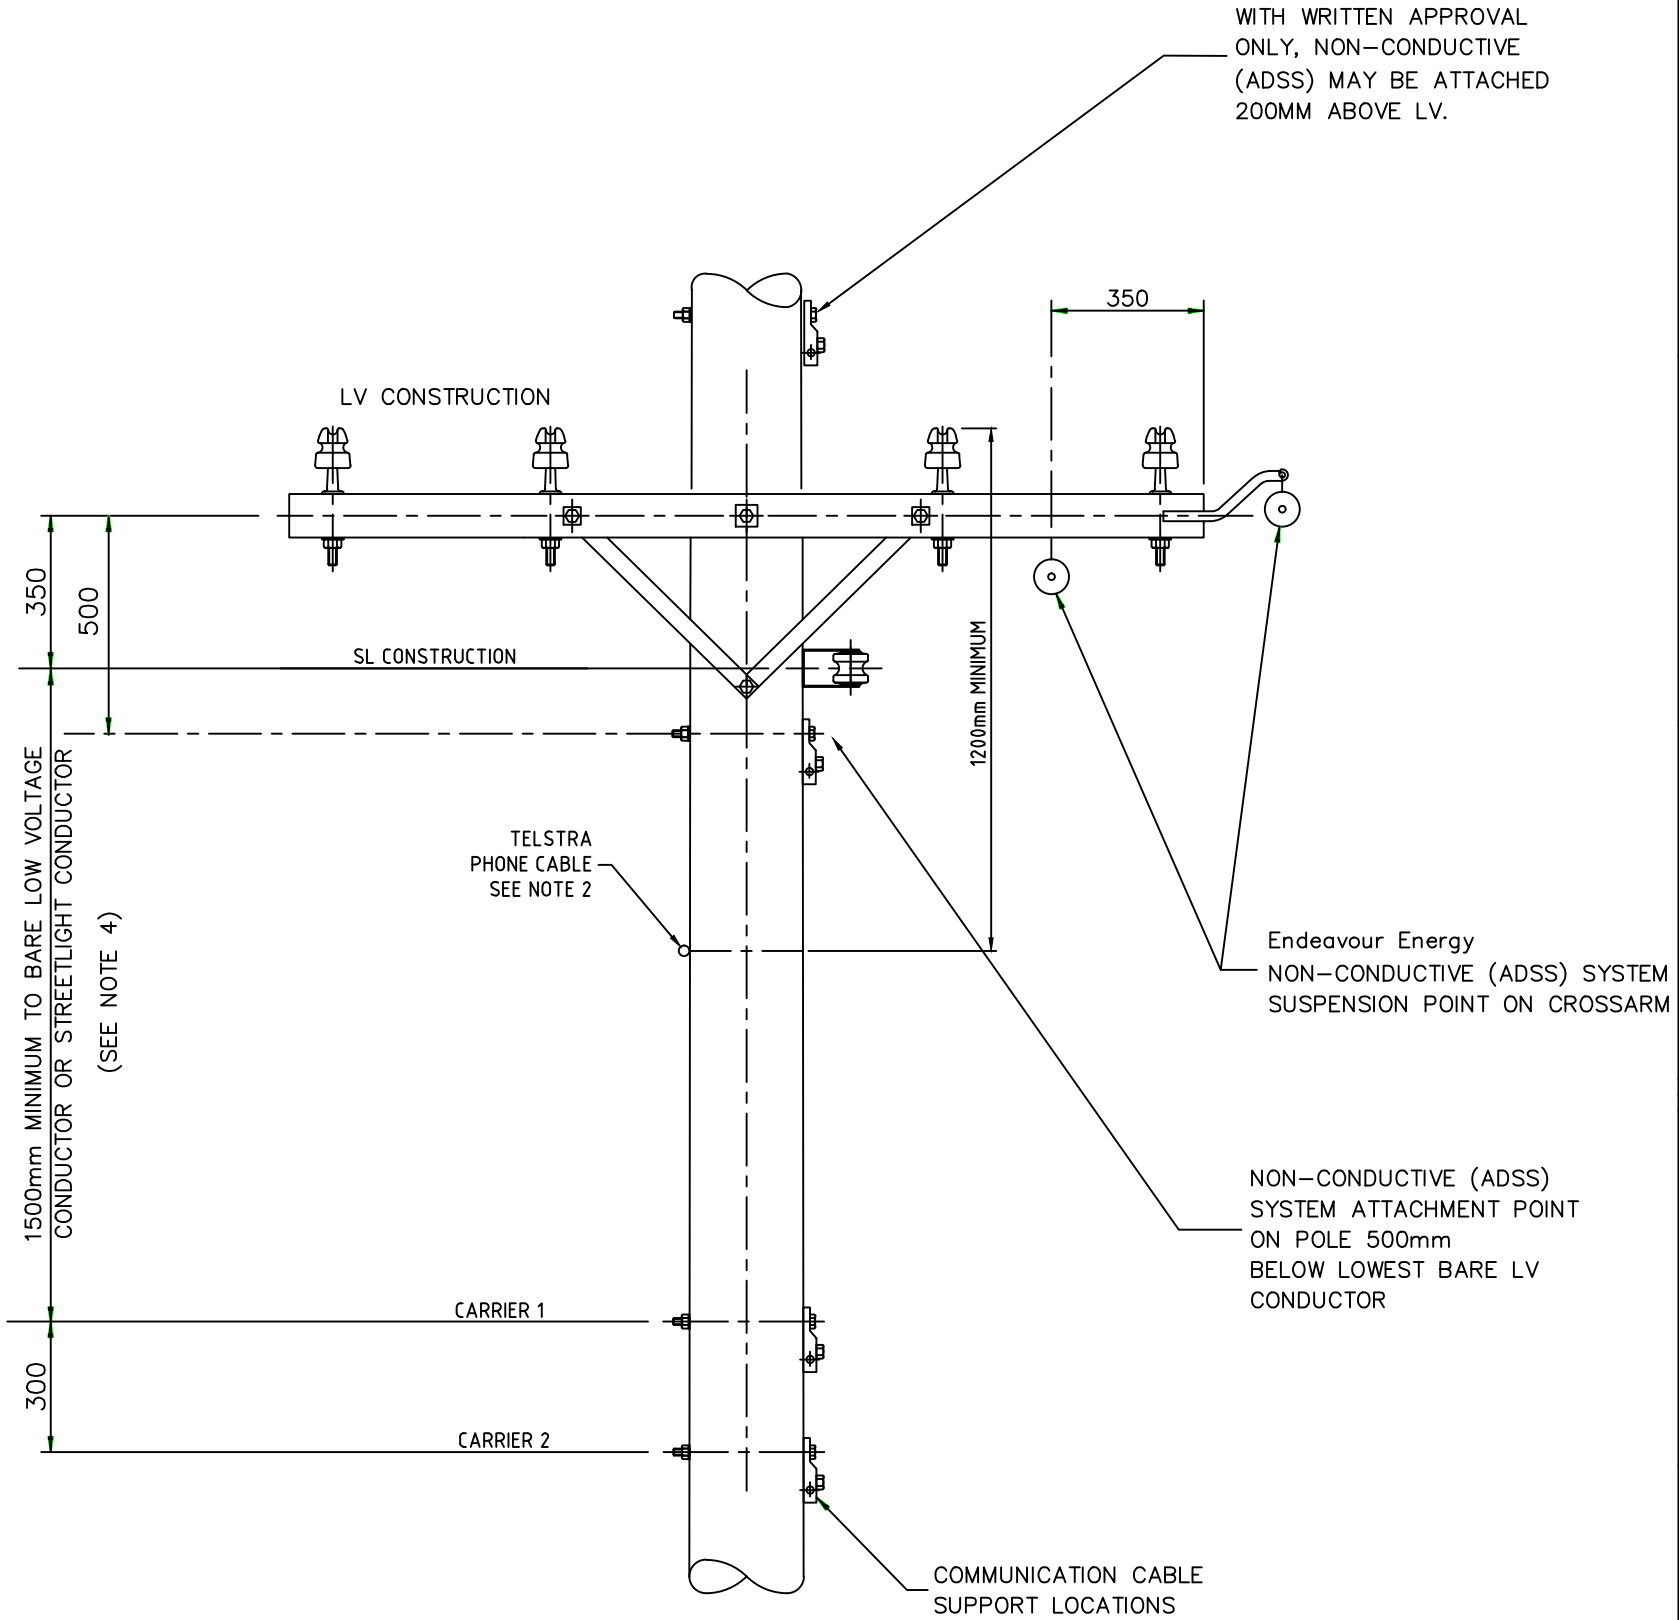

CONSTRUCTIONS WITH LV BARE AND SL CLEARANCES. REFER TO SHEET 1 FOR HV CLEARANCES.

		©This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.							
		ORIGINAL SCALE 1:12	APPROVED B.Hellyer	REFERENCE DRAWINGS					
				DO NOT SCALE DIMENSIONS IN MILLIMETRES		AUTHORISED B. Hellyer			
DRAWN	SM			COMMUNICATION CABLE CLEARANCES ON POLE WITH BARE MAINS			MAINS ASSETS MANAGER	24-01-18	
DATE	24-01-18						A4	078518	G
CH'D	BH								