| AMENDMENTS | |
|---|---|
| A | ORIGINAL ISSUE |

| Job No. | |
|---|---|
| DESIGN | N/A |
| DR'N | TV |
| CH'D | MA/MB |
| DATE | 24.12.25 |
| A.E.M. | S.P. |

## NOTES

1. MATERIAL: ANGLE STEEL 100 X 100 X 6 X 940 LG.
2. FINISH: HOT DIP GALVANISE IN ACCORDANCE WITH AS1650.
3. STAMP THE NUMBER 506710 IN 12mm HIGH NUMBERS WHERE SHOWN. NUMBERS TO BE VISIBLE AFTER GALVANISING.

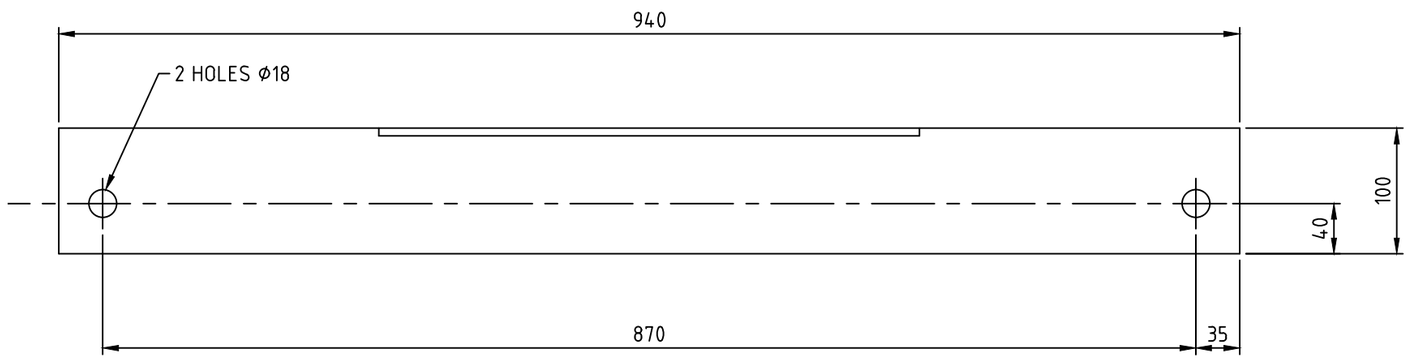


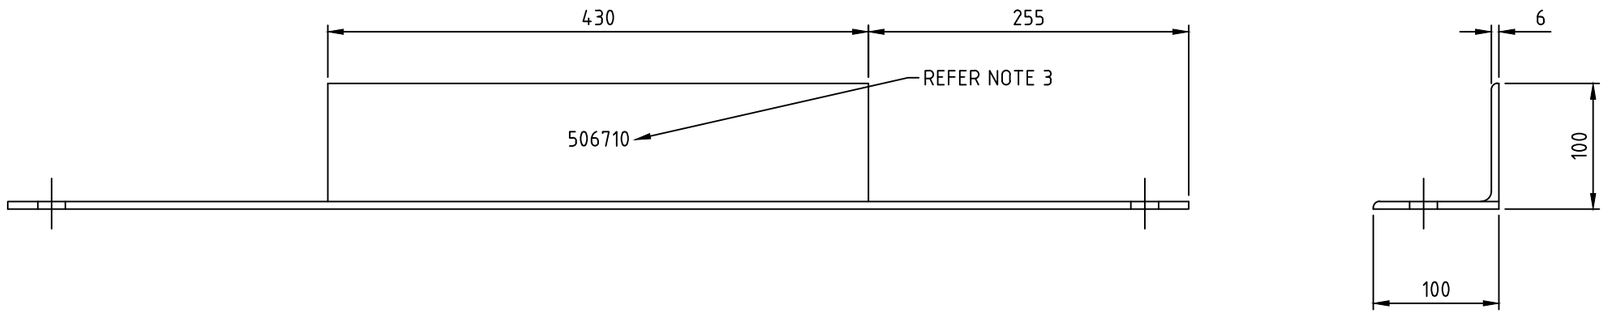


© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

| ORIGINAL SCALE | APPROVED |
|---|---|
| NTS | A.WICKRAMASINGHE |

| | | | |
|---|---|---|---|
| DRAWN | M.A. | | |
| DATE | 06.08.12 | | |
| CH'D | M.A. | | |

Endeavour Energy

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED
S.PATON
ASSET ENGINEERING MANAGER — 31.10.14

# OVERHEAD TRANSMISSION
# 132kV CONSTRUCTION
# 4.5M CROSS ARM BRACE DETAIL

A2P 537454 Rev. A

SHEET No 1 OF 1 SHEETS