NOTES

1. FOR LOCATION OF TRENCHING AND DUCT REQUIREMENTS REFER TO DUCT, EASEMENT AND TRENCHING REQUIREMENTS DRAWINGS.

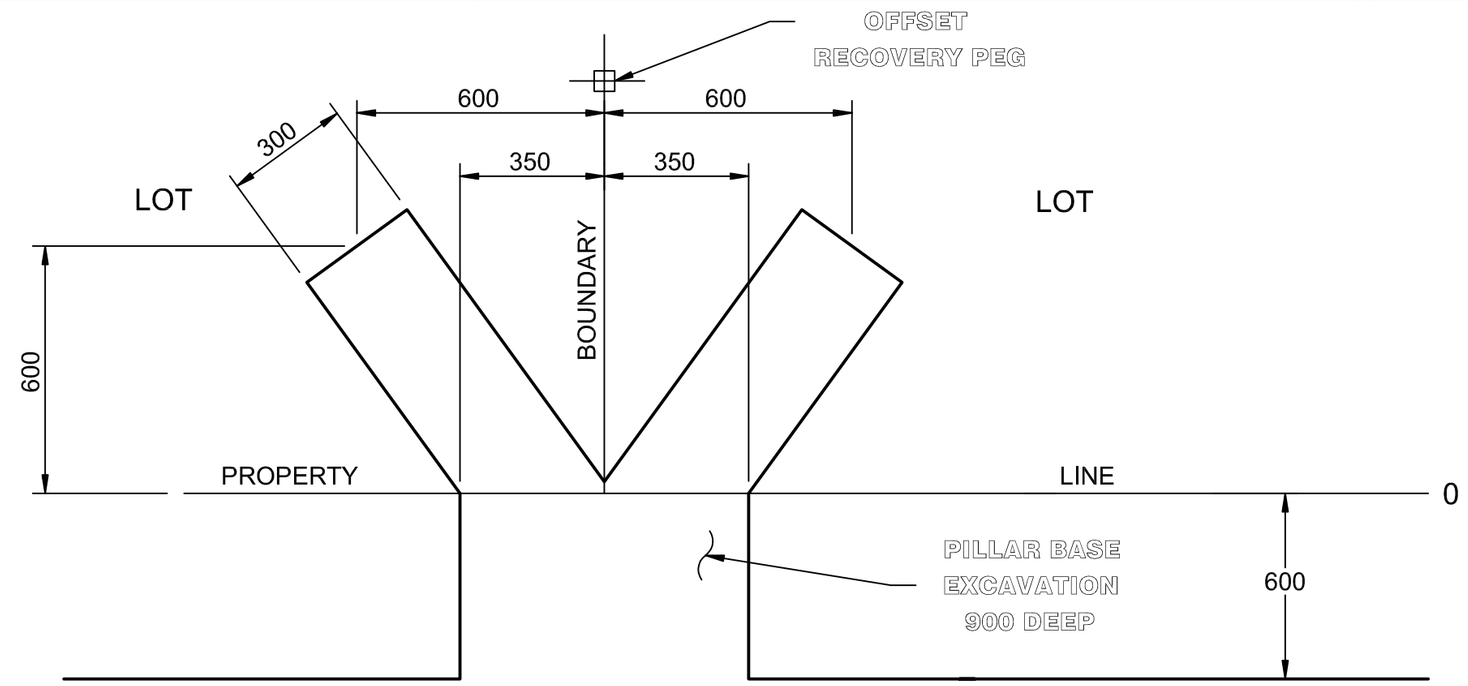

CABLE TRENCH

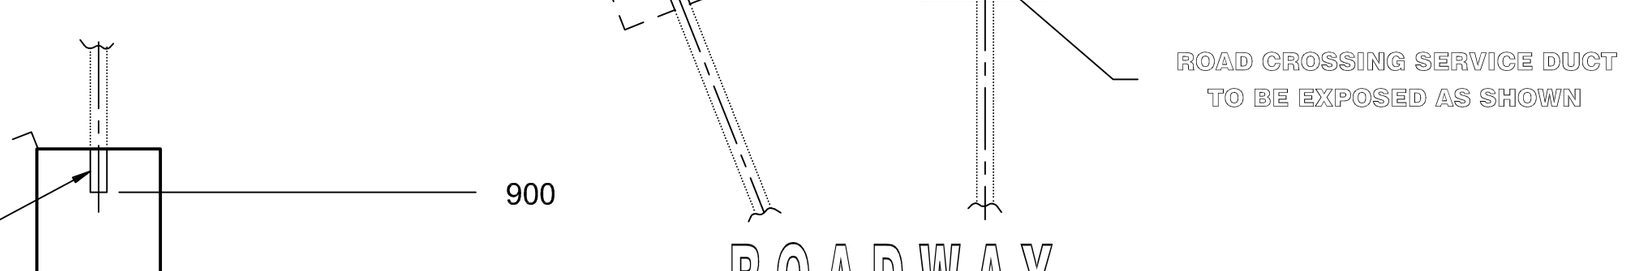

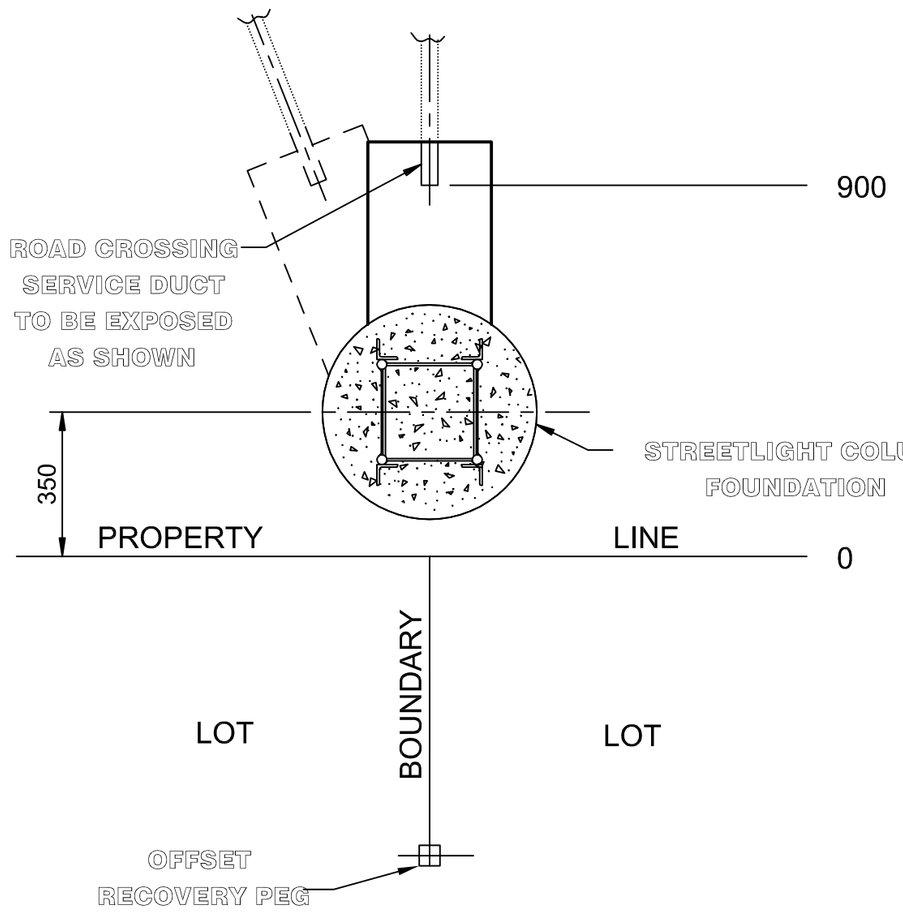

STREETLIGHT COLUMN JOINTING ENCLOSURE
EXCAVATION DETAIL

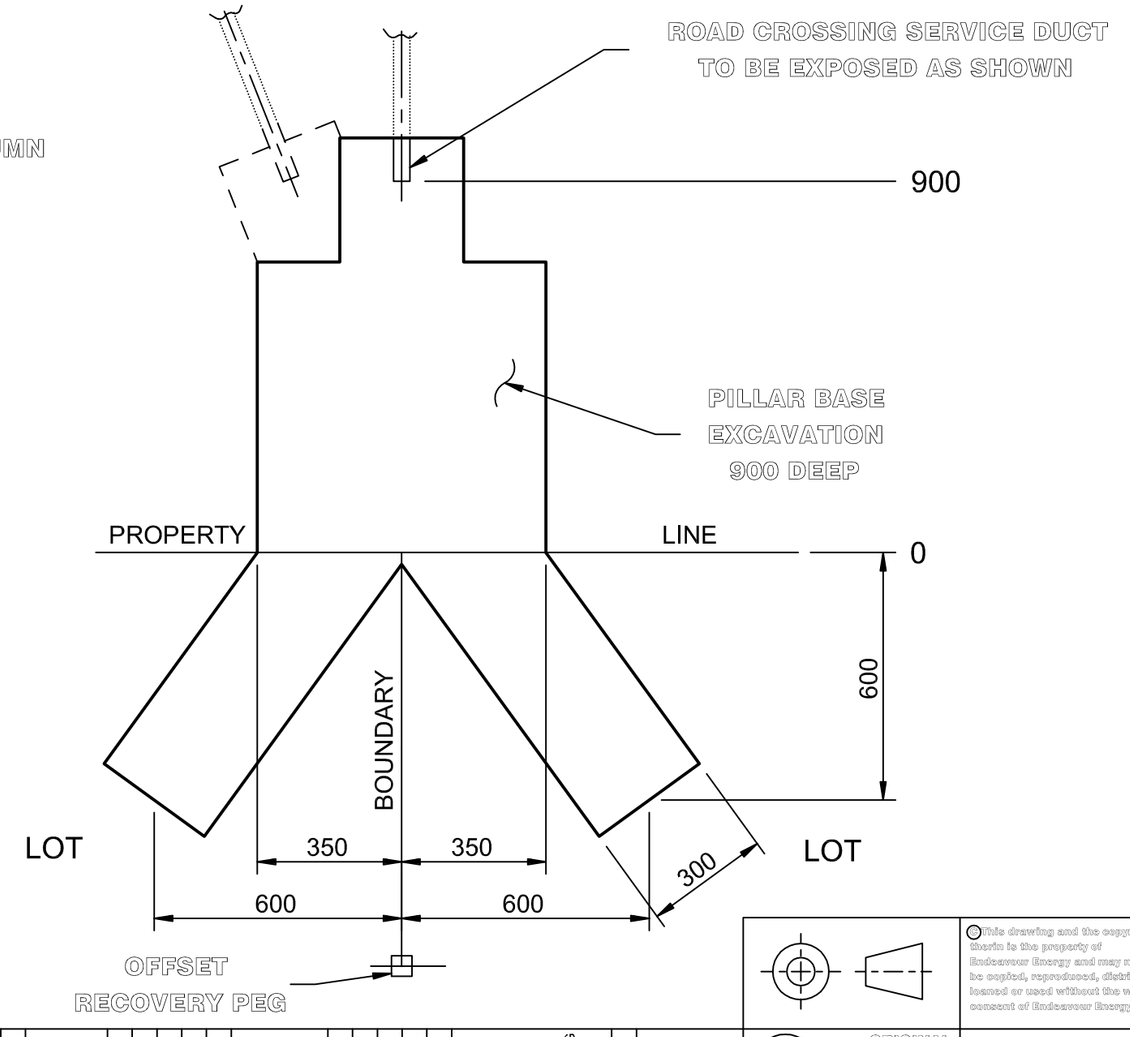

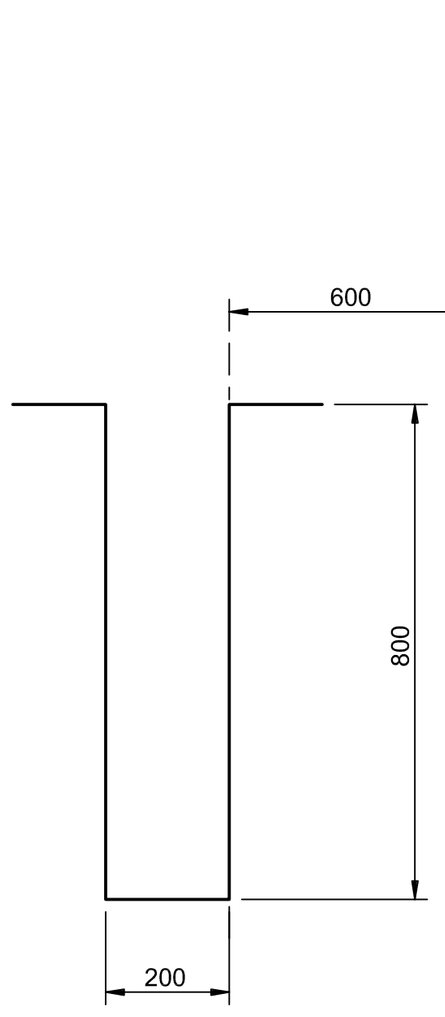

LOW VOLTAGE
CABLE TRENCH
SECTION

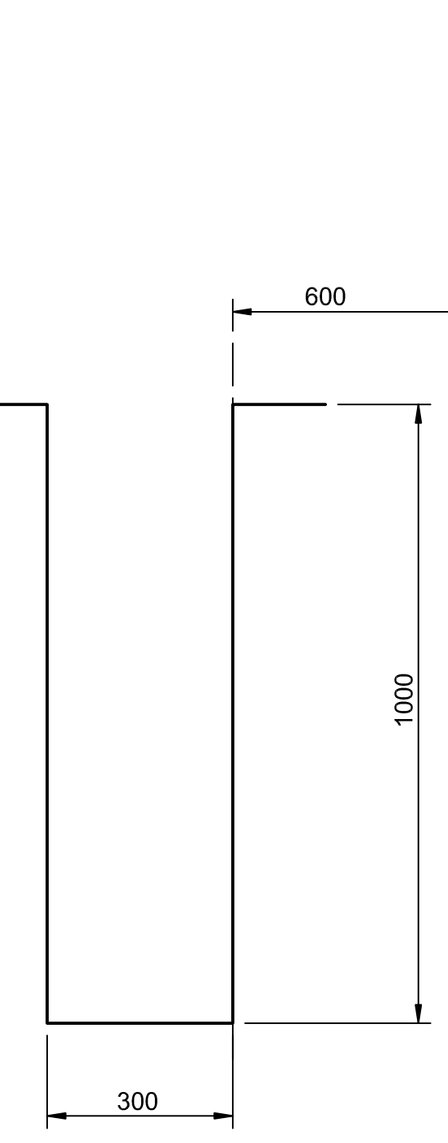

HIGH VOLTAGE
CABLE TRENCH
SECTION

AMENDMENTS

A ORIGINAL ISSUE — J R No. NA

C — DRN D.J.Z. — CH'D D.J.Z. — DATE 07-6-90 — JR No 890180
#1. REVISED EXCAVATION DETAILS, OFFSET RECOVERY PEG ADDED. J.W.

D — M.S.D. T.A.S. — DRN D.J.Z. — CH'D D.J.Z. — DATE 27-8-92 — JR No 920057
LOW VOLTAGE TRENCH WAS TWO DEEP HIGH VOLTAGE TRENCH WAS ONE DEEP
#1. REVISED EXCAVATION DETAILS, DEPTH OF EXCAVATION WAS 750 EXCAVATION OF STREETLIGHT COLUMN ADDED TITLE REVISED

E — M.S.D. B.M.D. — DRN D.J.Z. — CH'D D.J.Z. — DATE 28-9-94 — JR No 940149
NOTES REVISED. REF TO P.E. TECH. PUB. TO PE1ED.

F — M.D.M. B.M.D. — DRN D.J.Z. — CH'D D.J.Z. — DATE 20-11-96 — JR No 960076
TELSTRA WAS TELECOM

M.N.M.A. G.V.H. — DRN R.J.H. — CH'D R.J.H. — DATE 08-12-98 — JR No WX911144
NOTE 2 WAS 750 DEEP. TELSTRA DUCT TRENCH EXCAVATION DETAIL. TRENCH DEPTH REVISED.

D.A.S.M. M.D.T. — DRN G.S.F. — CH'D G.S.F. — DATE 21-07-05 — JR No –
LOW VOLTAGE TRENCH WAS 600 DEEP. HIGH VOLTAGE TRENCH WAS 900 DEEP.

M.A.E. G.F.O'D. — DRN M.C. — CH'D M.A. — DATE 25-11-2015 — JR No
REMOVE SERVICE CUTTINGS OFF COLUMNS. REALIGN 600mm FROM TRENCH CENTRE TO EDGE OF TRENCH. REMOVE NPOTE 2. REGARDING SHARED TRENCHES.
M.A.E.

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

ORIGINAL SCALE NONE

APPROVED D. SHEPHERD

DRAWN	D.J.Z.		
DATE	27-6-89		
CH'D	D.J.Z		

Endeavour Energy

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED
J. PERERA
MANAGER PRIMARY SYSTEMS

URD TRENCH SYSTEM EXCAVATION DETAILS

A2 060785 J
SHEET No 1 OF 1 SHEETS