



315KVA & 500KVA
PHASE ONLY
1 HOLE Ø18 LV PALM




1000KVA, 1500KVA PHASE
& ALL TRF NEUTRALS
2 HOLES Ø18 LV PALM


LV PALM DETAILS

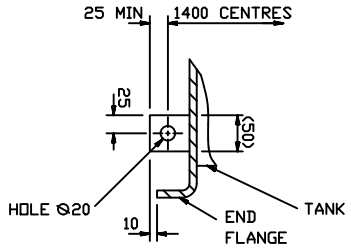


MOUNTING LUG DETAIL
PLAN VIEW

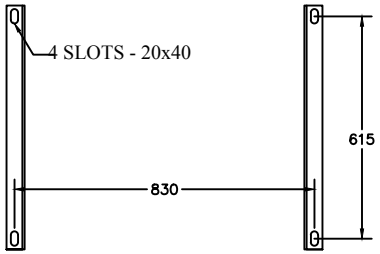


SUPPORT/MOUNTING ANGLES DETAIL
PLAN VIEW




HV BUSHING WELL DETAIL

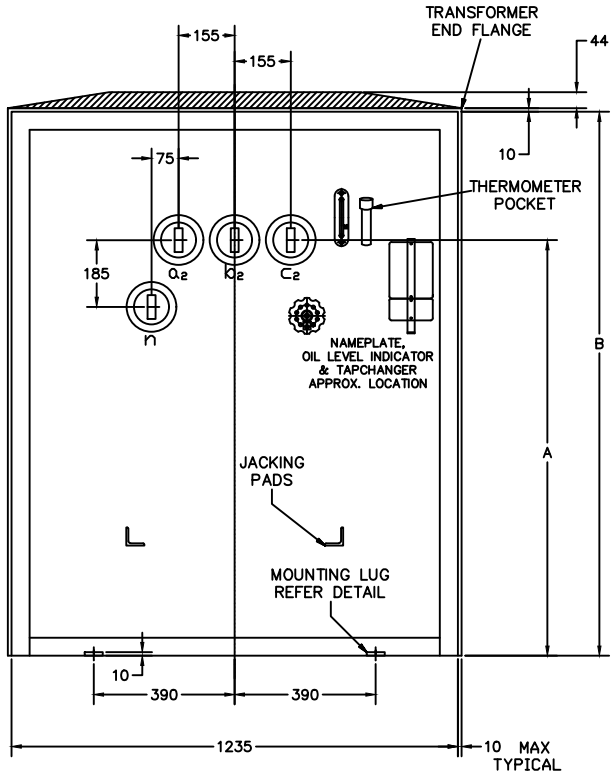

L.V. END

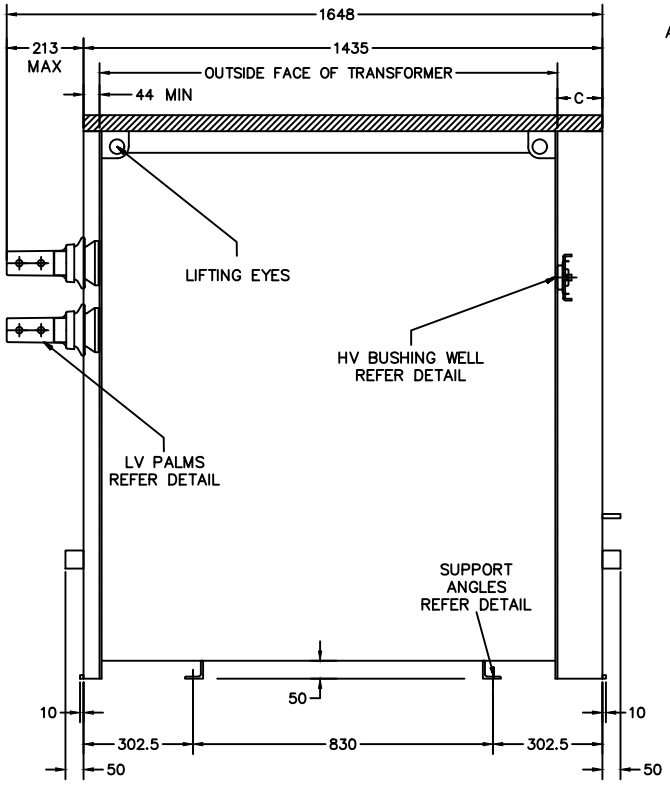

SIDE VIEW

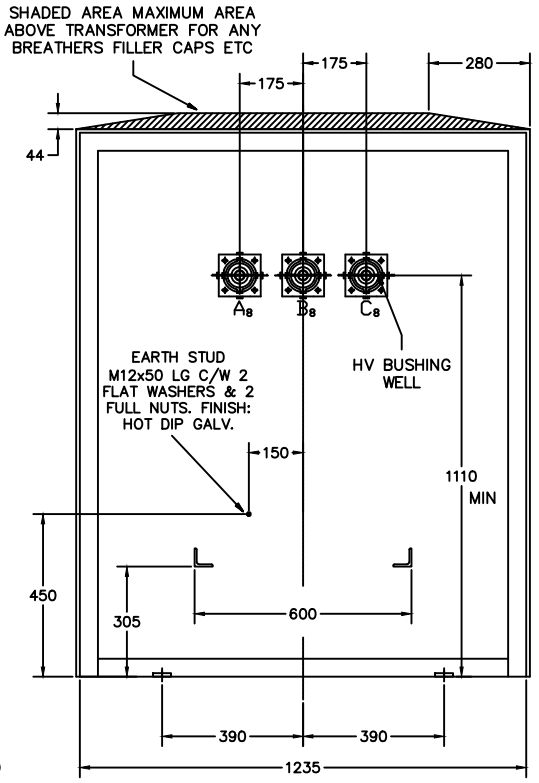

H.V. END

RATING OF TRANSFORMER			
	315 & 500kVA	1000kVA	1500kVA
DIM A	1150	1345	1345
DIM B	1275	1505	1505
DIM C	130	75	44

AMENDMENTS

A	ORIGINAL ISSUE	G.P.S	
B	DRN G.P.S; CH'D G.P.S; DATE 23-10-97; JR No 970067; TITLE WAS "300," K.M.S.A		
C	DRN B.C.H; CH'D B.C.H; DATE 02-10-98; JR No GD11100; 600 WAS 1700 & 1250; WAS 1450, (GR A4), 1465 & 1750 WAS 1550 MAX. (GR B3). NOTE 2 WAS HEIGHT: 1560 - 1600mm.		
D	DRN R.H; CH'D R.H; DATE 23-8-99; JR No W2011223; LAYOUT OF LV & HV ENDS REVISED. TABLE ADDED.	MNAT	
E	DRN G. Ford; CH'D G. Ford; DATE 25-6-2008; JR No; REDRAWN, TABLES AMENDED, HV BUSHING DETAILS ADDED	MDAS	G. Ford
F	DRN CSA; CH'D VM; DATE 26/11/04; JOB No; LV PALM HOLE DIAMETER CHANGED FROM 22 TO 18.	DSEP	VM
G	DRN G. Ford; CH'D G. Ford; DATE 26-11-15; JR No; LV NEUTRAL BUSHING NOW AT LEFT. LIFTING EYES SHOWN. THERMOPOCKET SHOWN.	NSW	C. Crisp. Fulli

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, issued or used without the written consent of Endeavour Energy.

ORIGINAL SCALE		APPROVED	G. Ford
DRAWN	B.G.H		
DATE	03/10/1997	INDEX REF.	S008A
CH'D	G.P.S		

Endeavour Energy

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

REFERENCE DRAWINGS

AUTHORISED
Glen Ford

MANAGER SUBSTATION STANDARDS 03/10/1997

SIZE 14-315,500KVA & SIZE 16-1000,1500KVA
PADMOUNT & INDOOR TRANSFORMER
TYPICAL REQUIREMENTS

A3 | 245887 | G

SHEET No 1 OF 1 SHEETS