AMENDMENTS	
A	ORIGINAL ISSUE
J R No.	920101
B	D'RN JMD CH'D S.J.P DATE 21-8-92 JR No 920194 DIM 5000 WAS 5500 (REF. F4)
S.D.E.	P.M.
C	D'RN P.M.M.O CH'D P.M. DATE 16-9-92 JR No .. PAGE NOS REMOVED NOTES AMENDED.
S.D.E.	P.M.
D	DR'N C.R.T. CH'D D.J.Z. DATE 15-7-93 JR No 930117 TITLE AMENDED. NOTE 1 AMENDED. NOTE 5 ADDED.
S.D.E.	J.K.
E	DR'N C.R.T. CH'D D.J.Z. DATE 28-10-93 JR No 930206 SDI 117 WAS TP9.
S.D.M.	J.K.
F	DR'N D.J.Z. CH'D D.J.Z. DATE 25-8-95 JR No 950159 NOTE 2 REVISED. NORMAL INSTALLATION HEIGHT CLEARANCE WAS 3200mm. FOOTING REF DRGS DELETED.
M.S.S.	J.K.
G	DR'N D.J.Z. CH'D D.J.Z. DATE 05-2-96 JR No 960001 NOTE 1 REVISED. ISSUE ID SDI 104, 114 & 117 DELETED. NOTES 2,3 & 4 SDI 104 WAS SDI 105.
SEO	S.O.
H	DR'N R.J.H. CH'D R.J.H. DATE 04-7-96 JR No 960051 DIM 5500 WAS 5000 (F4).
SEO	J.K.
J	DR'N P.G.H. CH'D J.K. DATE 20-10-98 JR No GZ911100 EASEMENT AREA FINISH NOTE DELETED. CLAUSES REMOVED FROM NOTES 2,3 & 4.
MNSA	J.K.
K	DR'N R.J.H. CH'D R.J.H. DATE 18-6-99 JR No WX911159 11kV PADMOUNT FTG WAS 2970 x 1290.
MNAT	J.K.

NOTES

1. PADMOUNT FOOTING DIMENSIONS;
   11/22kV PADMOUNT – 3190mm X 1370mm
2. HEIGHT REQUIRED ABOVE PADMOUNT FOOTING FOR NORMAL INSTALLATION TO BE 5500mm.
   WHERE HEIGHT IS RESTRICTED BELOW 5500mm REFER TO SDI 104.
3. EXCEPT AS NOTED IN SDI 104,
   ANY METAL FENCING, WITHIN THE AREA DEFINED BY A LINE 4000mm FROM FOOTING EXTREMITIES & THE EASEMENT BOUNDARY, IS TO BE CONSTRUCTED SO THAT ADJACENT PANELS ARE ISOLATED FROM EACH OTHER & FROM THE GROUND.
4. EXCEPT AS NOTED IN SDI 104,
   ANY METAL CLAD BU1LDING SHOULD NOT ENCROACH W1THIN THE AREA DEFINED BY A L1NE 4000mm FROM THE FOOTING EXTREMITIES.

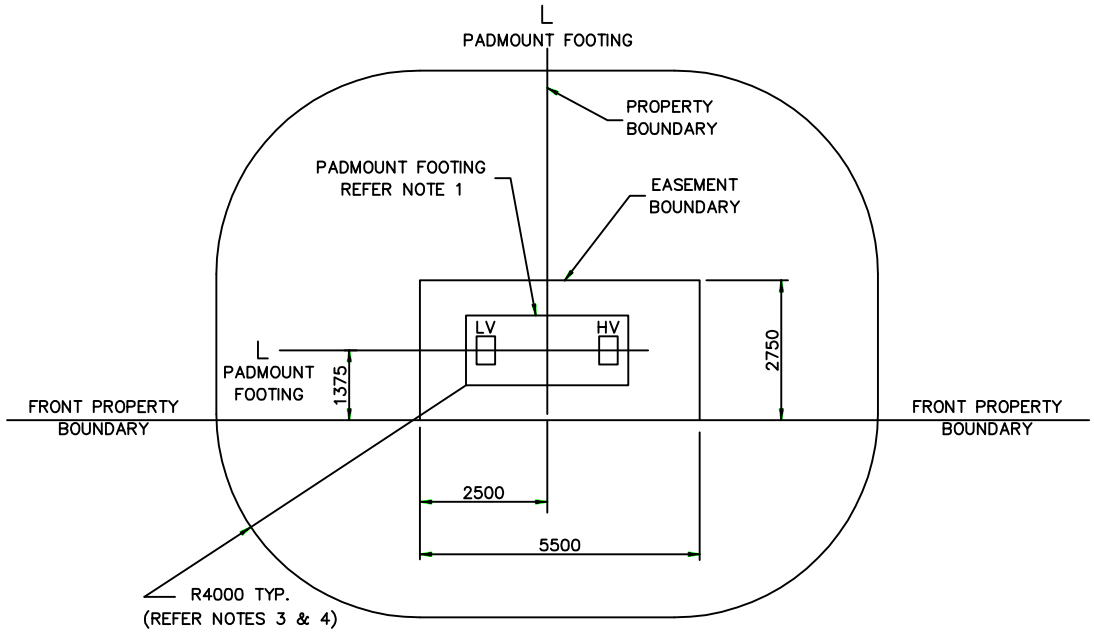

UNDERGROUND RESIDENTIAL DEVELOPMENT
WHERE BUILDING SETBACKS ARE LESS THAN 7.5 METRES

– SUBSTATION TO BE POSITIONED WHEREVER POSSIBLE ON LOW SIDE OF @U STREET. IF SUBSTATION MUST BE POSITIONED ON HIGH SIDE, DIM 2750 @U MUST BE INCREASED TO 4000 AND DIM 1375 MUST BE INCREASED TO 2625 @U TO CLEAR WATER BOARD SEWERS.

– FOOTING MAY BE ROTATED THROUGH 180 DEGREES. @U
– MULTIPLE PADMOUNTS NOT APPLICABLE IN THIS CASE.

©This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

Endeavour Energy

FENCE ISOLATED PANEL INST DET	061674	
REFERENCE DRAWINGS	DRG. NO.	THIS ISSUE PAGE NO

ORIGINAL SCALE 1:75	APPROVED C.Howat	DO NOT SCALE DIMENSIONS IN MILLIMETRES	D.B.Brixton/C– ASSIST. G.M. ENG. 18-5-92	ISSUE IDENTIFICATION
DRAWN P.M.M.		11kV & 22kV PADMOUNT SUBSTATION EASEMENT LAYOUT	SUB 016665 K	THIS ISSUE
DATE 18-5-92			SHEET No 2 OF 2 SHEETS	
CH'D D.J.Z.			INDEX REF S001E	PAGE NO.