NOTES

1. ALL MEASUREMENTS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.
2. METALLIC FENCES WITHIN A SQUARE CENTRED AROUND THE TRANSMISSION LINE SUPPORT STRUCTURE (WITH DIMENSION "X" EQUAL TO THE EASEMENT WIDTH) REQUIRE ISOLATION PANELS AT OR NEAR THE POINT WHERE THE FENCE LEAVES THE SQUARE.
3. ISOLATED FENCE PANELS ARE NOT TO BE EARTHED.
4. FENCES THAT ARE PARALLEL WITH THE OVERHEAD LINE WILL NOT BE PERMITTED WITHIN 5m FROM ANY POLE OR STRUCTURE.
5. FENCES THAT BISECT THE OVERHEAD LINE WILL NOT BE PERMITTED WITHIN 15m FROM ANY POLE OR STRUCTURE.
6. FENCES ERECTED ACCROSS AN EASEMENT MUST HAVE GATES INSTALLED WITH 4m WIDE MINIMUM OPENING.

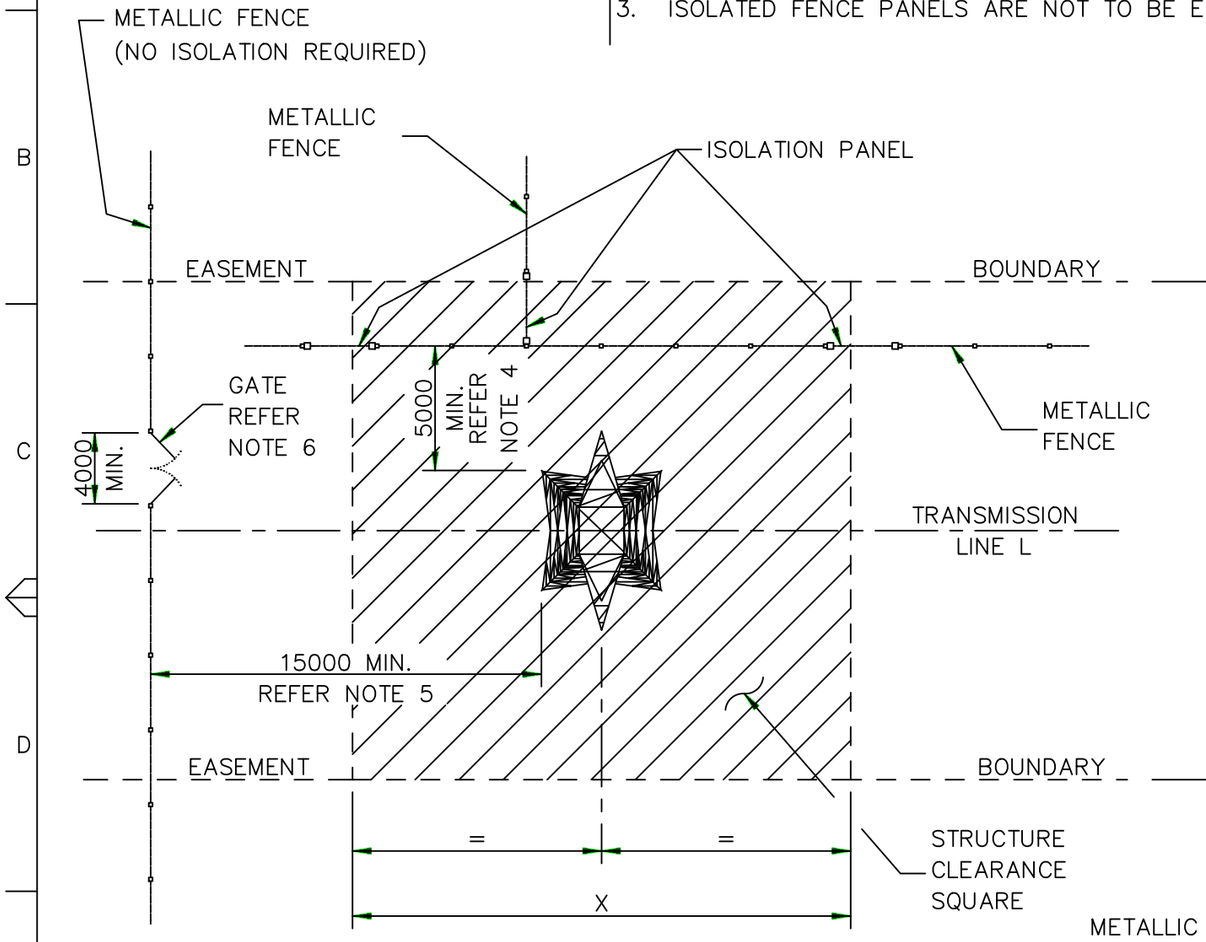

SITE EXAMPLE 1
(REFER NOTE 2)

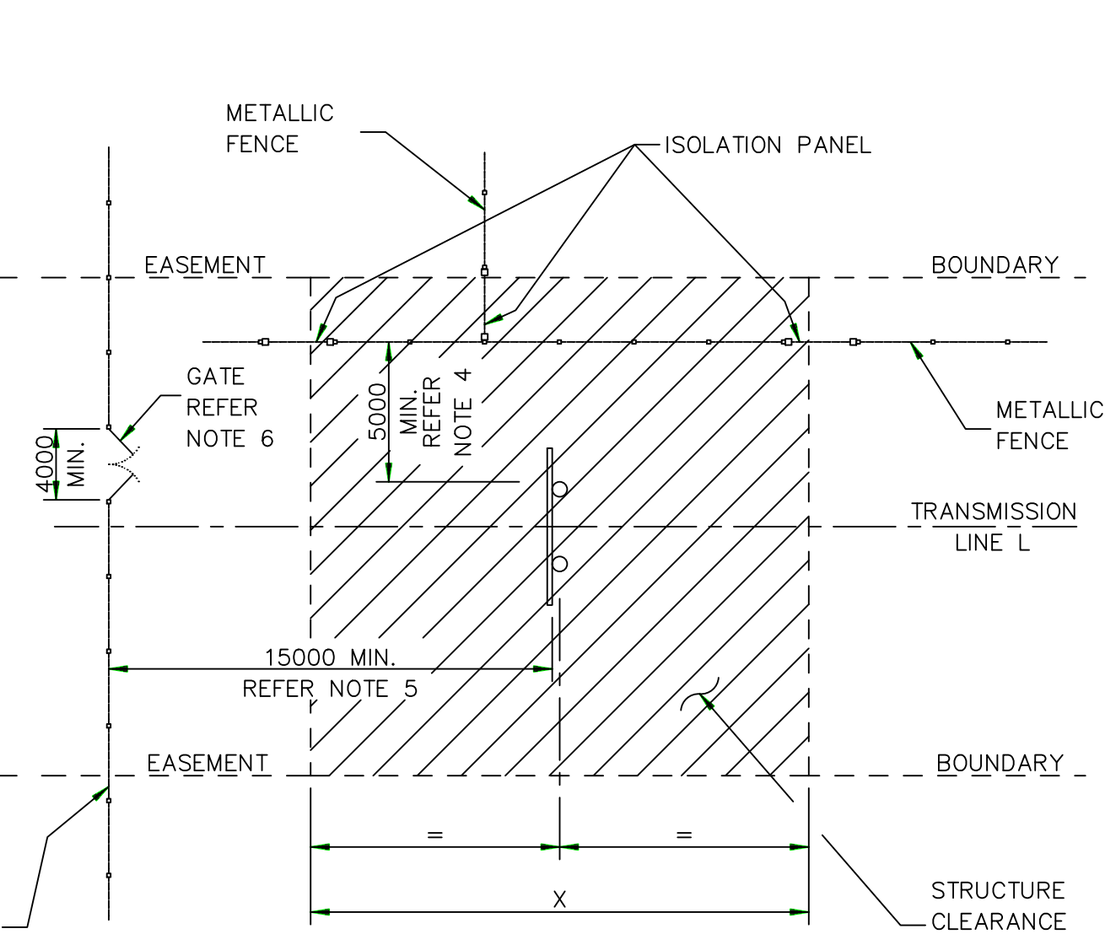

SITE EXAMPLE 2
(REFER NOTE 2)

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

Endeavour Energy

CHAIN WIRE FENCE ISOL. PANEL	242451
SOLID METALLIC FENCE ISOL. PANEL	069575
REFERENCE DRAWINGS	

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED
W.Isley

ORIGINAL SCALE 1:250

APPROVED
Franco Pace

DRAWN	G.P.S.		
DATE	31-1-97		
CH'D	G.P.S.		

AMENDMENTS

J R No.		
960086	ORIGINAL ISSUE	A

TRANSMISSION LINE STRUCTURE
METALLIC FENCE
CLEARANCE AND ISOLATION PANEL
REQUIREMENTS

MGR NETWORK MAINS ASSETS 26-02-97

A3 242450 A

SHEET No 1 OF 1 SHEETS