
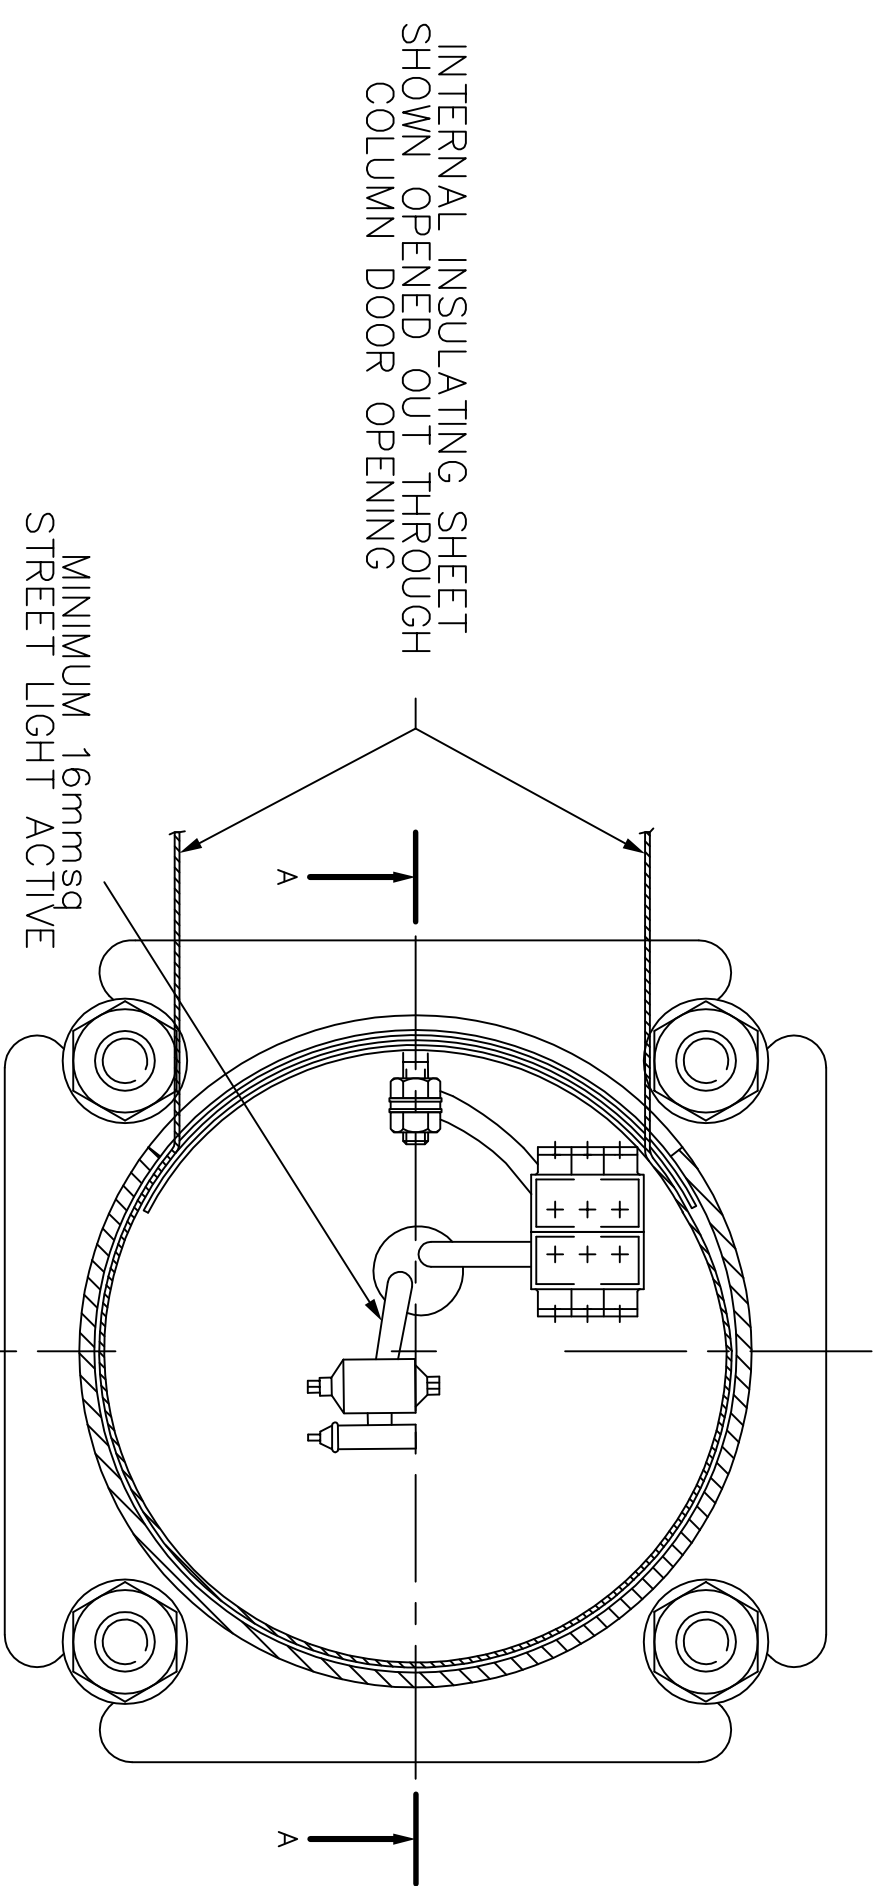


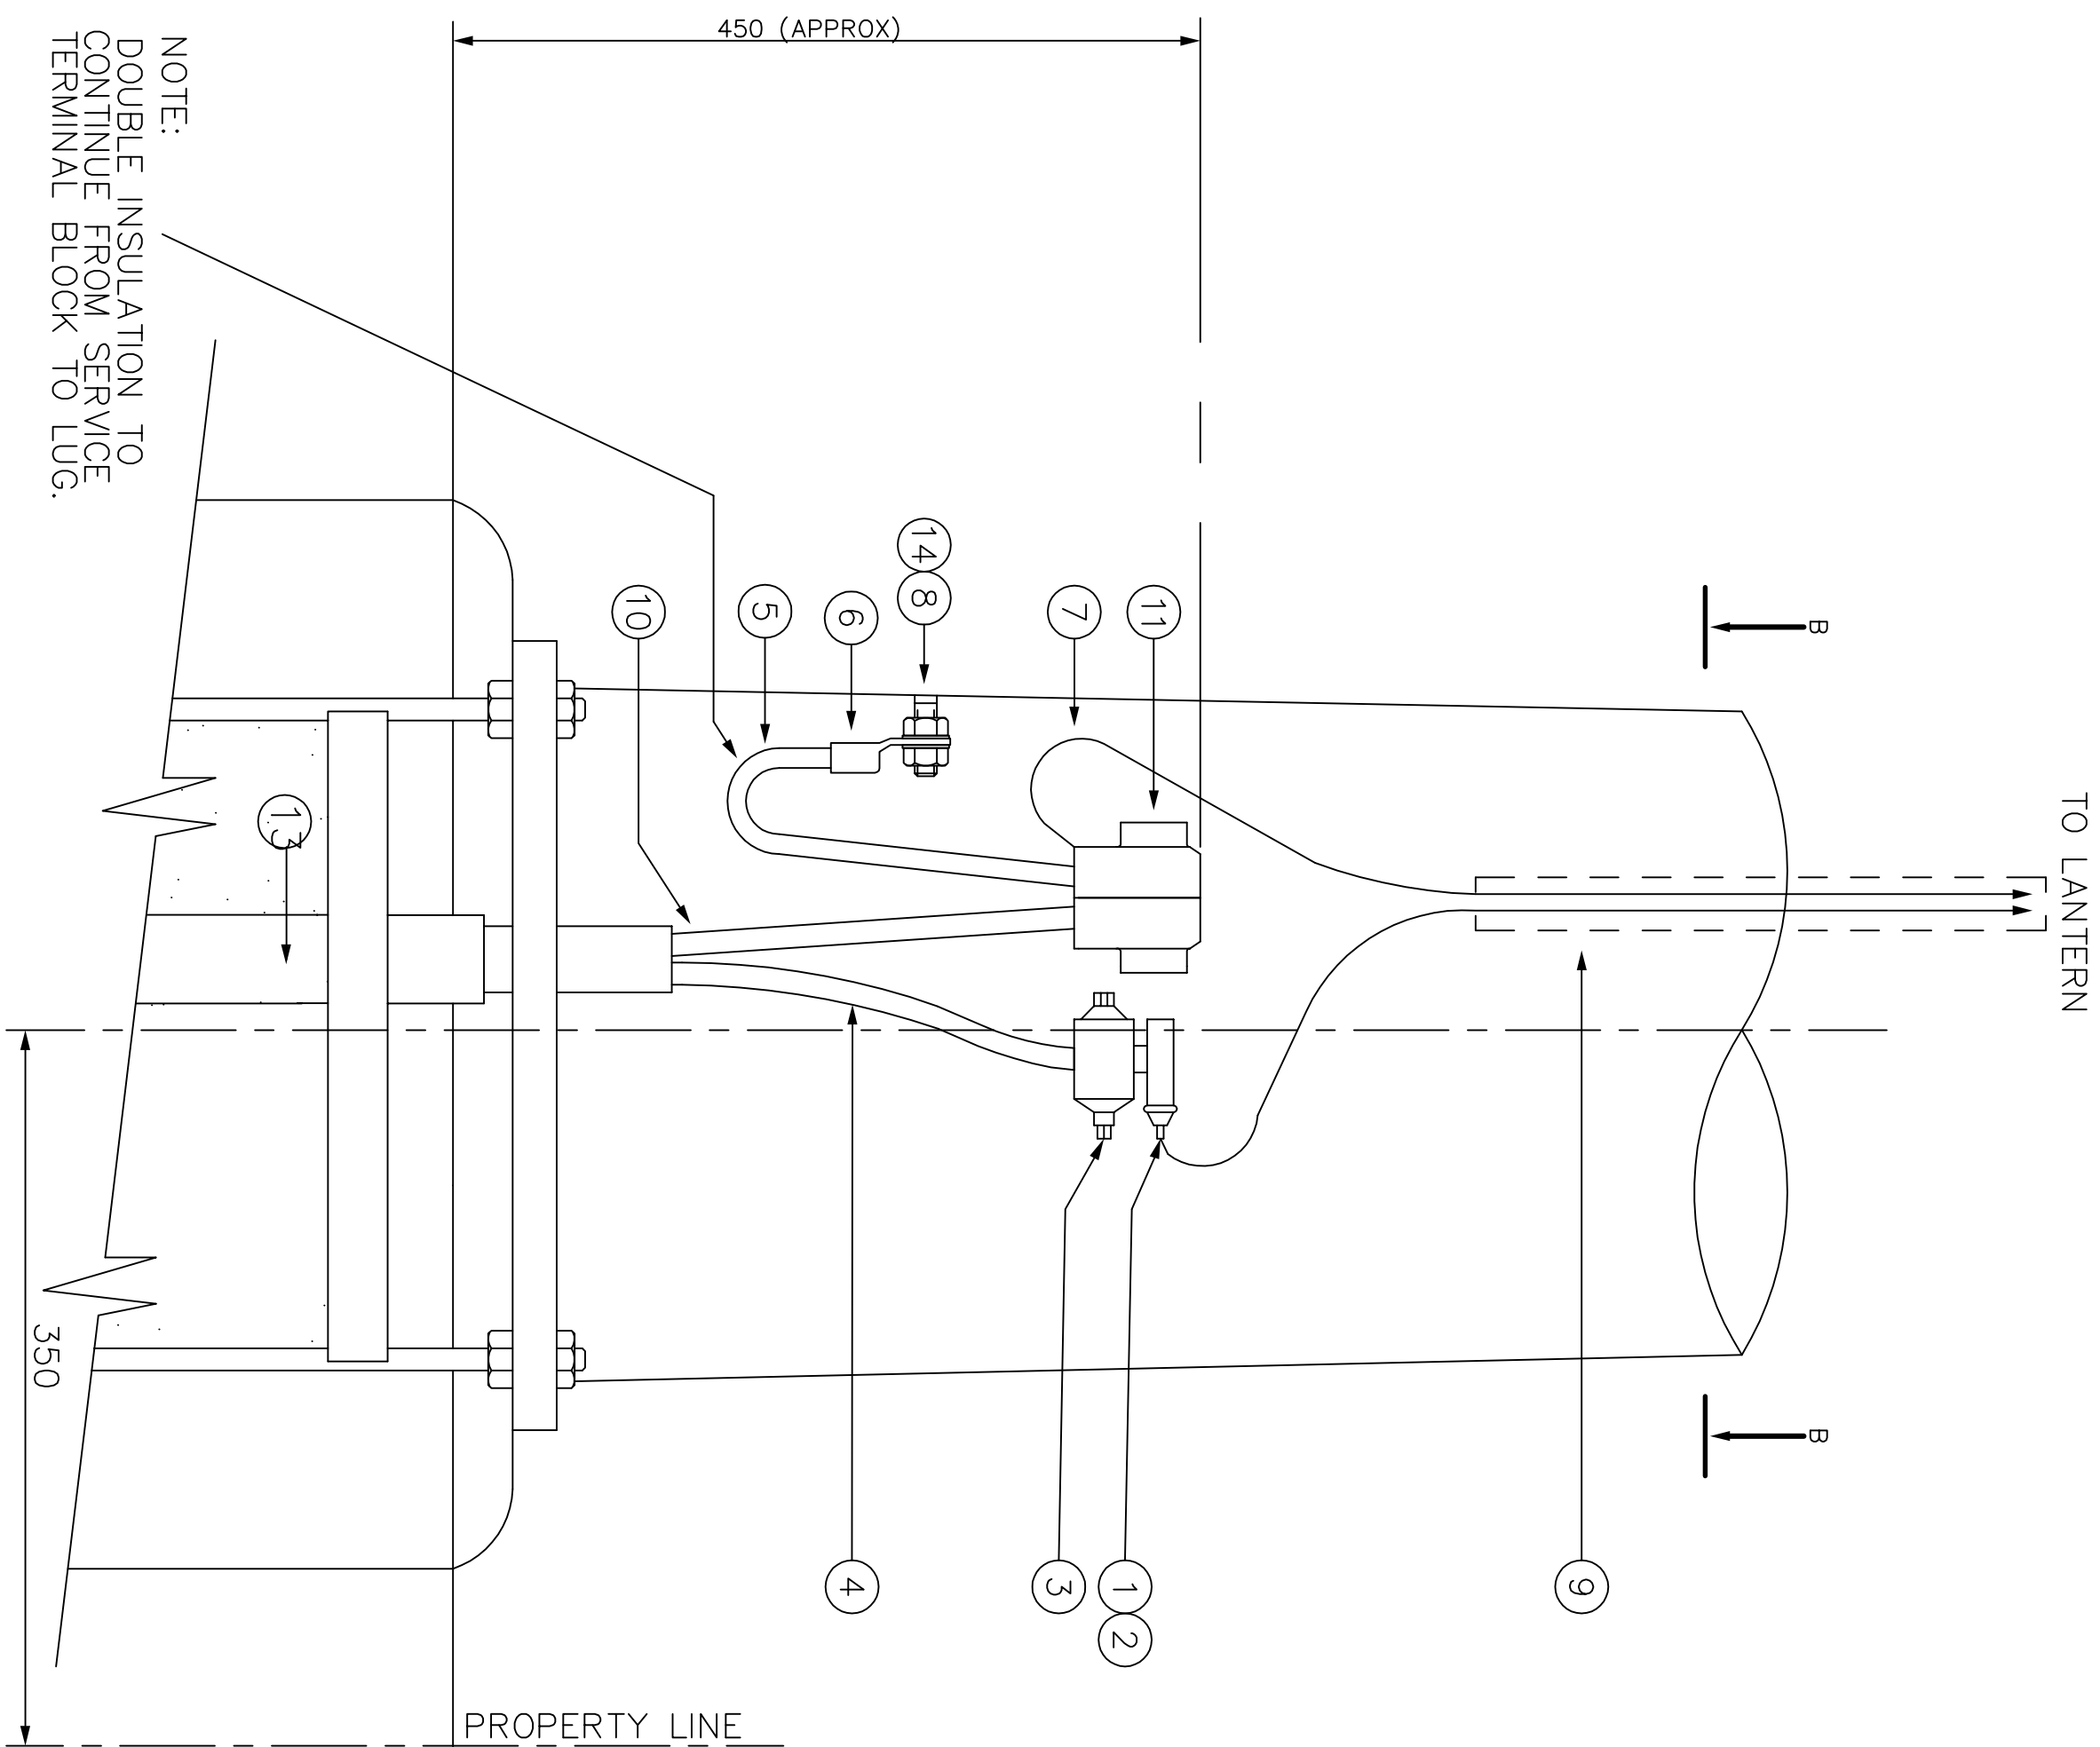

QTY	ITEM	DESCRIPTION	STOCK REF.
—	—	—	
2	14	M10 SS WASHER	SW10167
1	13	50mm UPVC H.D	1005900
—	12	—	—
1	11	SERVICE CABLE TERMINAL BLOCK — NEUTRAL	SB10509
1	10	50mmsq, 4 CORE, 1kV, XLPE CABLE	SZ10012
1	9	2x1.5mm sqr SINGLE CORE COPPER CONDUCTOR	001551076
2	8	S/STEEL LOCKING NUT — M10 — EARTH STUD	SN12319
1	7	LANTERN NEUTRAL CONNECTION	
1	6	70mmsq Cu CABLE LUG — M10	SL12727
1	5	70mmsq S.D.I EARTH CONDUCTOR	SZ10780
1	4	MIN 16mmsq S.D.I ACTIVE CONDUCTOR	SZ12643
1	3	I.P.C — 6/54MM TO 6/35MM	1066286
1	2	FUSE CARTRIDGE — 10 AMP	1145424
1	1	FUSE CARRIER	1145416

AMENDMENTS					
A	ORIGINAL ISSUE				
J R No.	DA				
B	DR'N	GSF			
	CH'D	GSF			
	DATE	11-9-05			
	JR No	--			
3 HOLE SERVICE BLOCK REPLACED IPC EARTH WIRE NOW 70mm					
M.A.E.	GSF				
DRAWN	DFL	APPROVED	© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.		
DATE	25.6.03	APPROVED			
CH'D	DPM	APPROVED			
PUBLIC LIGHTING CONSTRUCTION STANDARDS STREET LIGHT ONLY CONNECTION ARRANGEMENT END OF CIRCUIT			DO NOT SCALE DIMENSIONS IN MILLIMETRES		
A3			REFERENCE DRAWINGS		
SHEET No 1 OF 1 SHEETS			AUTHORISED AUTHOURISED		
280255 B					