


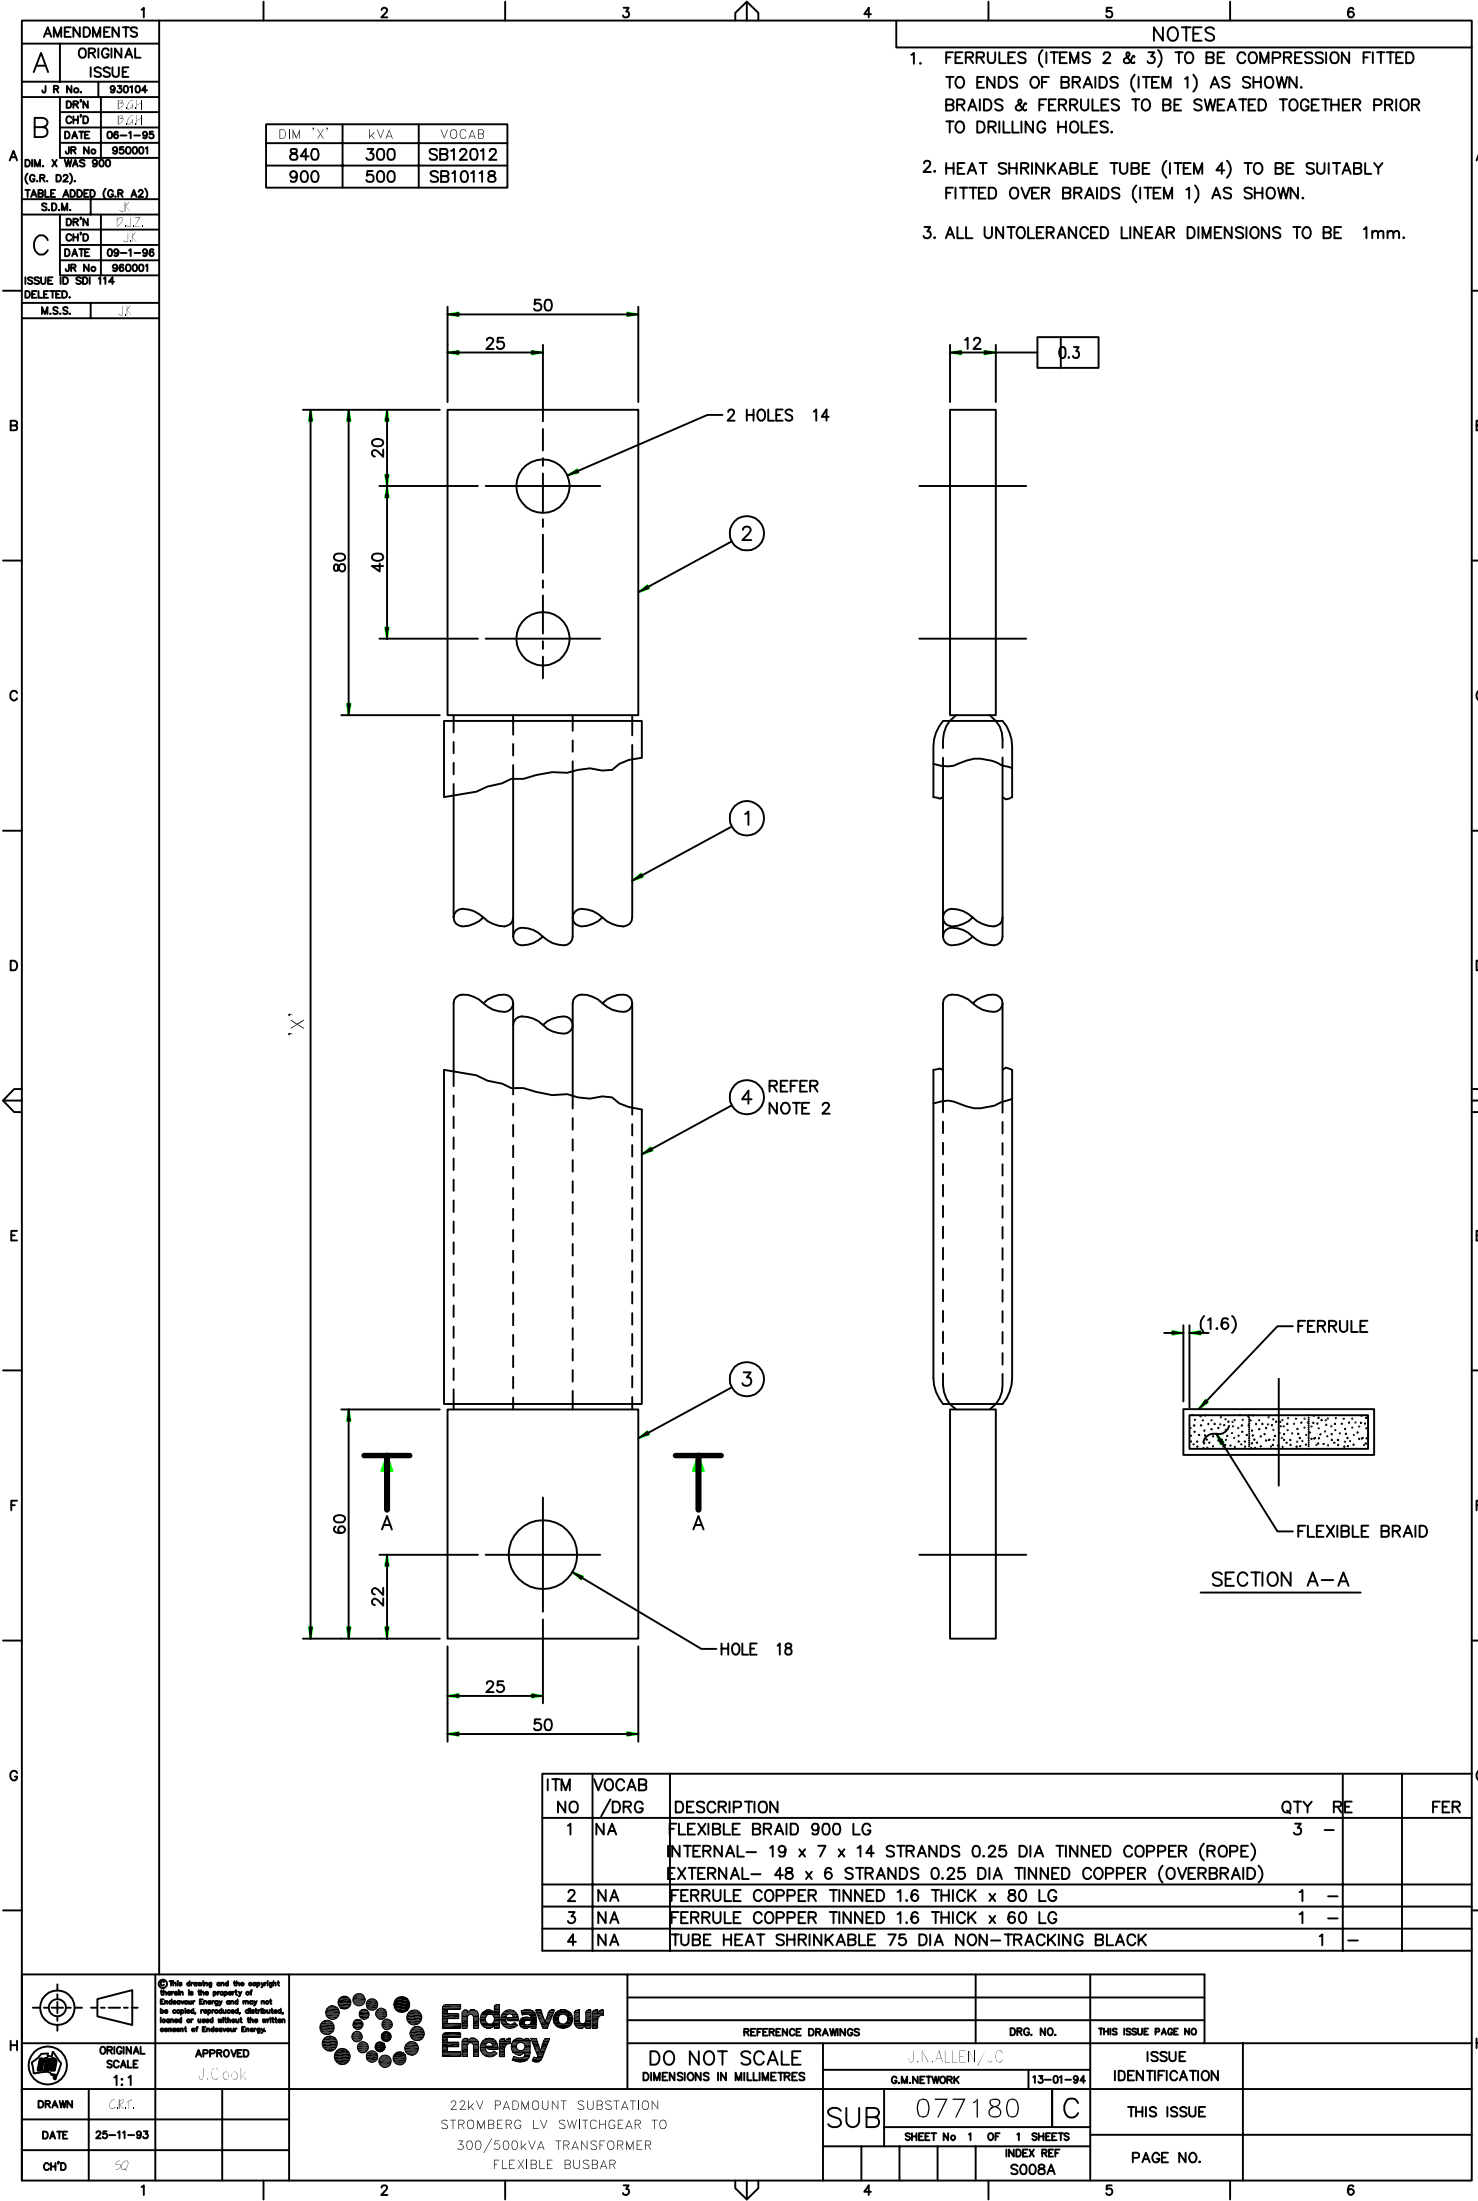

AMENDMENTS	
A	ORIGINAL ISSUE
J R No.	930104
DRN	P.01
CHD	P.01
DATE	06-1-95
JR No	950001
DIM. X WAS 900 (G.R. D2).	
TABLE ADDED (G.R. A2)	
S.D.M.	J.
DRN	P.01
CHD	P.01
DATE	09-1-96
JR No	960001
ISSUE D' SOT 114 DELETED.	
M.S.S.	J.

DIM 'X'	kVA	VOCAB
840	300	SB12012
900	500	SB10118

- NOTES
- FERRULES (ITEMS 2 & 3) TO BE COMPRESSION FITTED TO ENDS OF BRAIDS (ITEM 1) AS SHOWN. BRAIDS & FERRULES TO BE SWEATED TOGETHER PRIOR TO DRILLING HOLES.
 - HEAT SHRINKABLE TUBE (ITEM 4) TO BE SUITABLY FITTED OVER BRAIDS (ITEM 1) AS SHOWN.
 - ALL UNTOLERANCED LINEAR DIMENSIONS TO BE 1mm.

ITM NO	VOCAB /DRG	DESCRIPTION	QTY	RE	FER
1	NA	FLEXIBLE BRAID 900 LG INTERNAL- 19 x 7 x 14 STRANDS 0.25 DIA TINNED COPPER (ROPE) EXTERNAL- 48 x 6 STRANDS 0.25 DIA TINNED COPPER (OVERBRAID)	3	-	
2	NA	FERRULE COPPER TINNED 1.6 THICK x 80 LG	1	-	
3	NA	FERRULE COPPER TINNED 1.6 THICK x 60 LG	1	-	
4	NA	TUBE HEAT SHRINKABLE 75 DIA NON-TRACKING BLACK	1	-	

22kV PADMOUNT SUBSTATION
STROMBERG LV SWITCHGEAR TO
300/500kVA TRANSFORMER
FLEXIBLE BUSBAR

DO NOT SCALE DIMENSIONS IN MILLIMETRES	J.N.ALLEN/J.C G.M.NETWORK 13-01-94	DRG. NO.	THIS ISSUE PAGE NO
SUB	077180	C	ISSUE IDENTIFICATION
SHEET No 1 OF 1 SHEETS		THIS ISSUE	
INDEX REF S008A		PAGE NO.	