


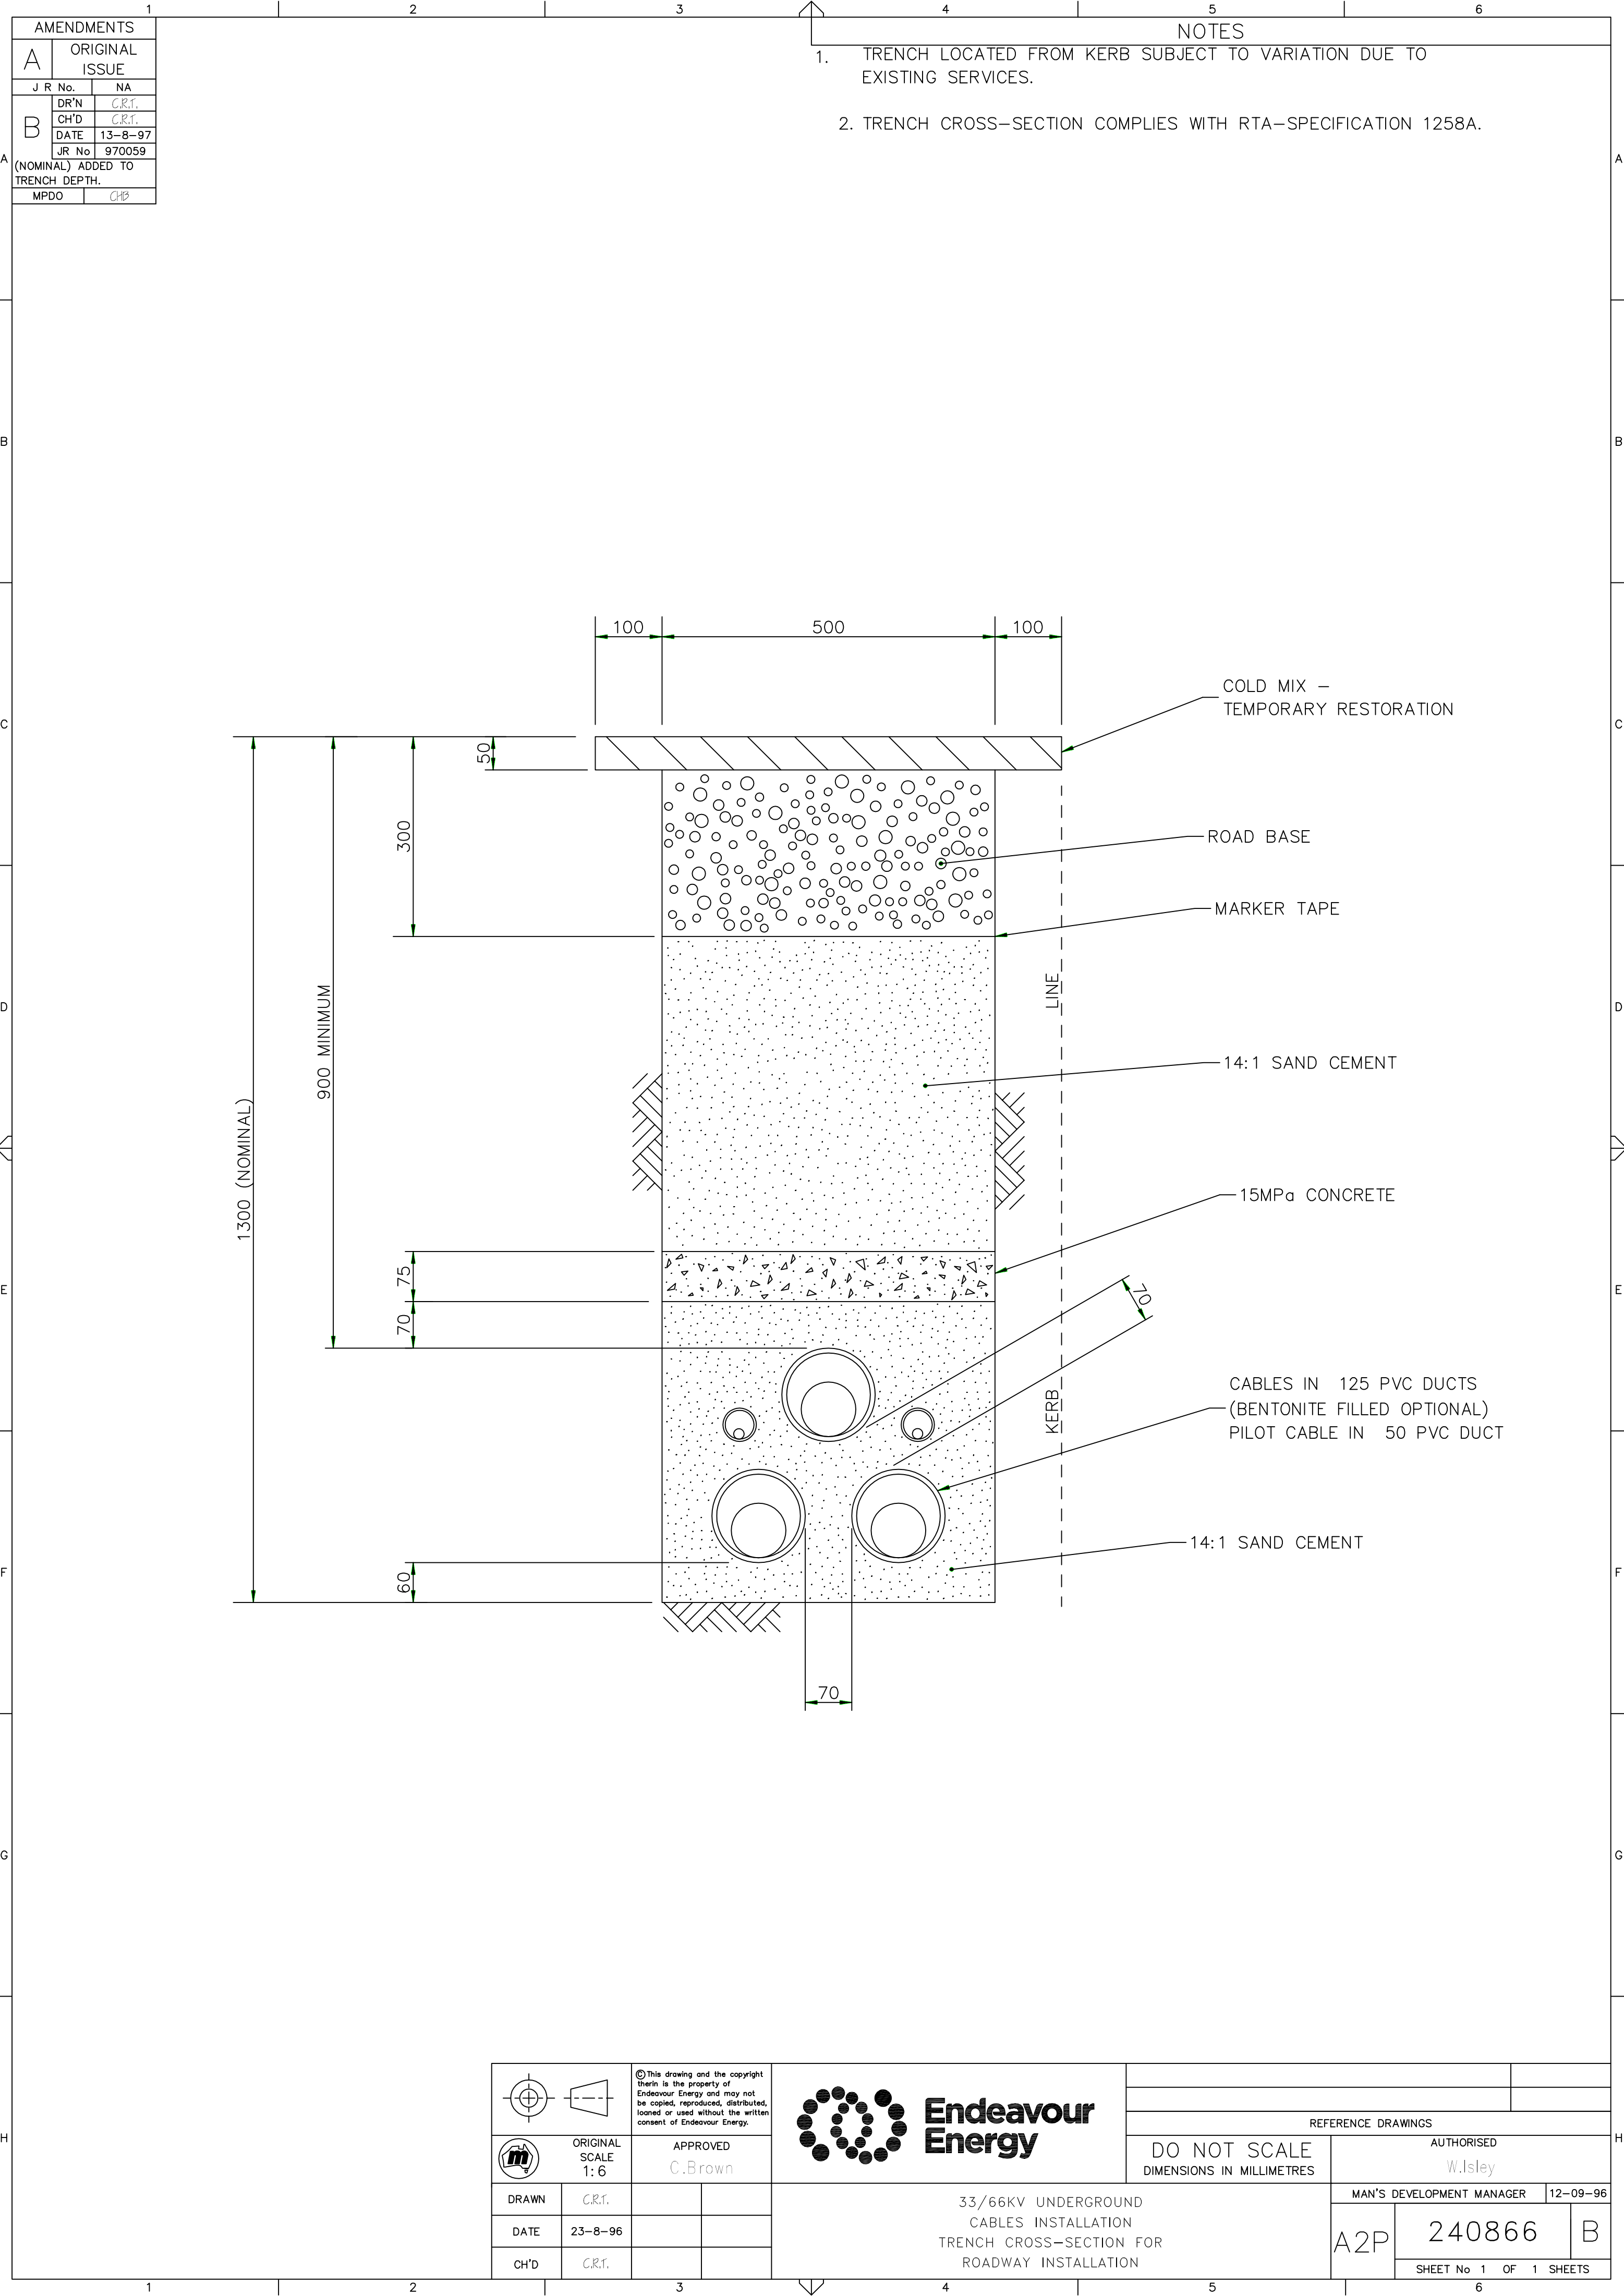

AMENDMENTS		
A	ORIGINAL ISSUE	
J R No.		NA
B	DR'N	C.R.T.
	CH'D	C.R.T.
	DATE	13-8-97
	JR No	970059
(NOMINAL) ADDED TO TRENCH DEPTH.		
MPDO		CHB

NOTES		
1. TRENCH LOCATED FROM KERB SUBJECT TO VARIATION DUE TO EXISTING SERVICES.		
2. TRENCH CROSS-SECTION COMPLIES WITH RTA-SPECIFICATION 1258A.		

ORIGINAL SCALE
1: 6

APPROVED
C.Brown

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

33/66KV UNDERGROUND
CABLES INSTALLATION
TRENCH CROSS-SECTION FOR
ROADWAY INSTALLATION

REFERENCE DRAWINGS
AUTHORISED
W.Isley

DRAWN
C.R.T.

DATE
23-8-96

CH'D
C.R.T.

MAN'S DEVELOPMENT MANAGER
12-09-96

A2P
240866
SHEET No 1 OF 1 SHEETS

B

33/66KV UNDERGROUND
CABLES INSTALLATION
TRENCH CROSS-SECTION FOR
ROADWAY INSTALLATION