




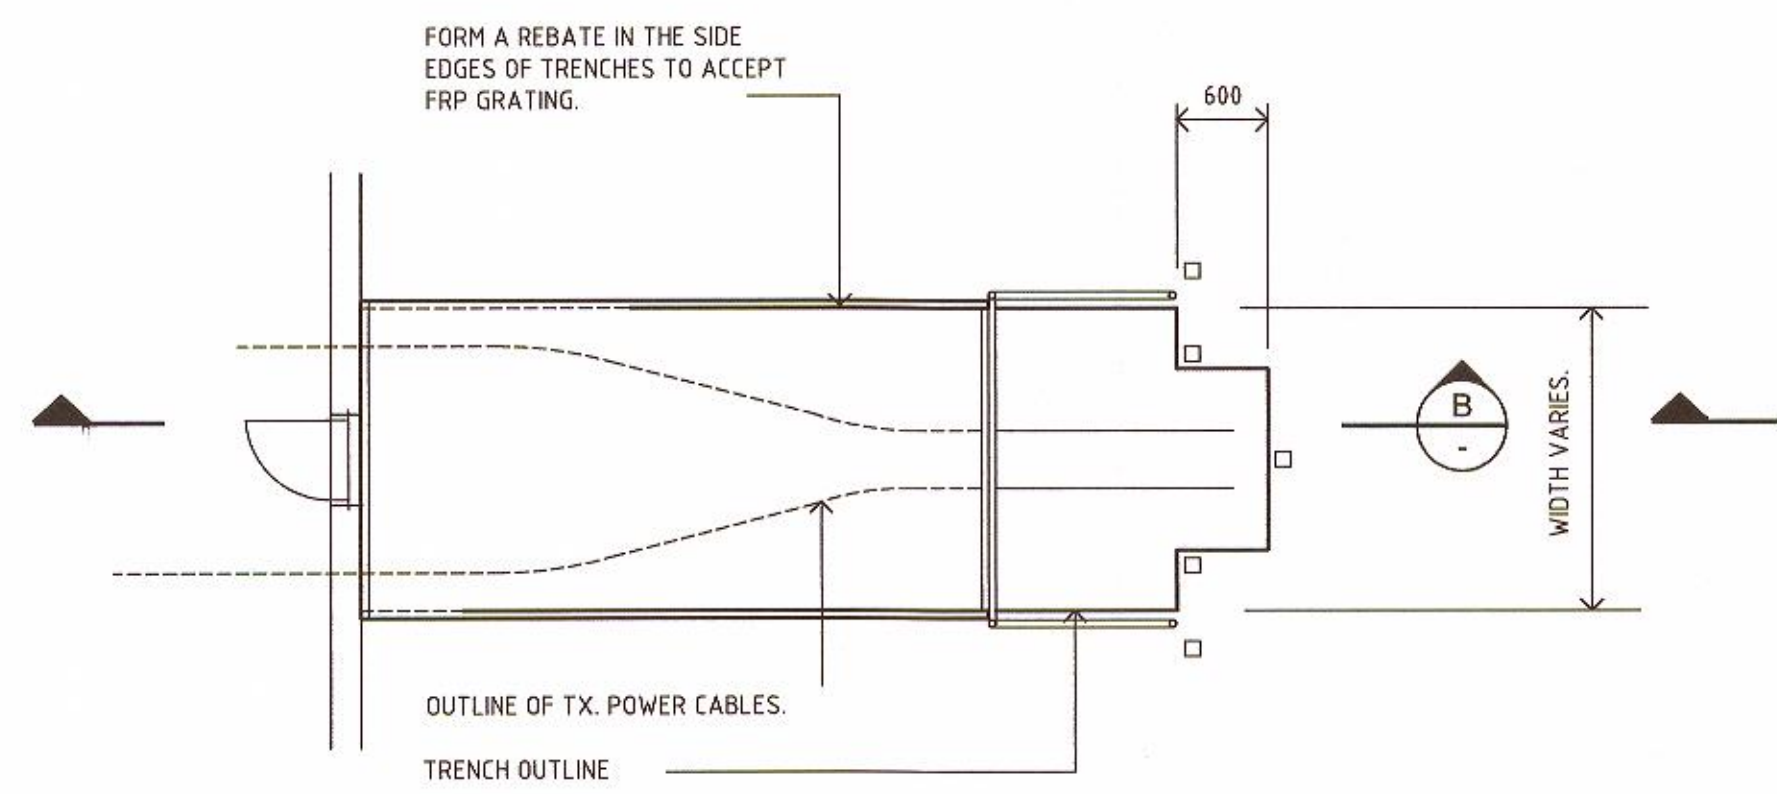


CABLE TRENCH PLAN

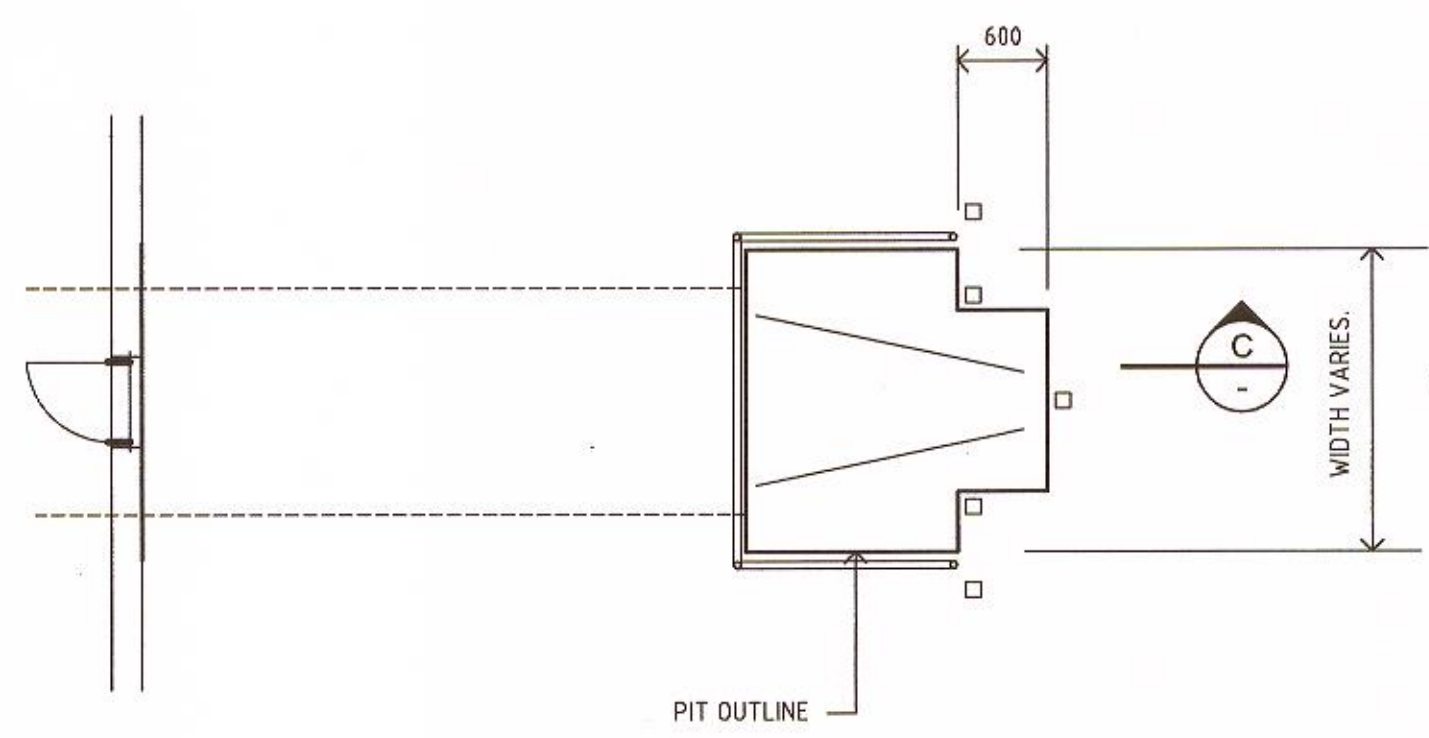

CABLE PIT PLAN

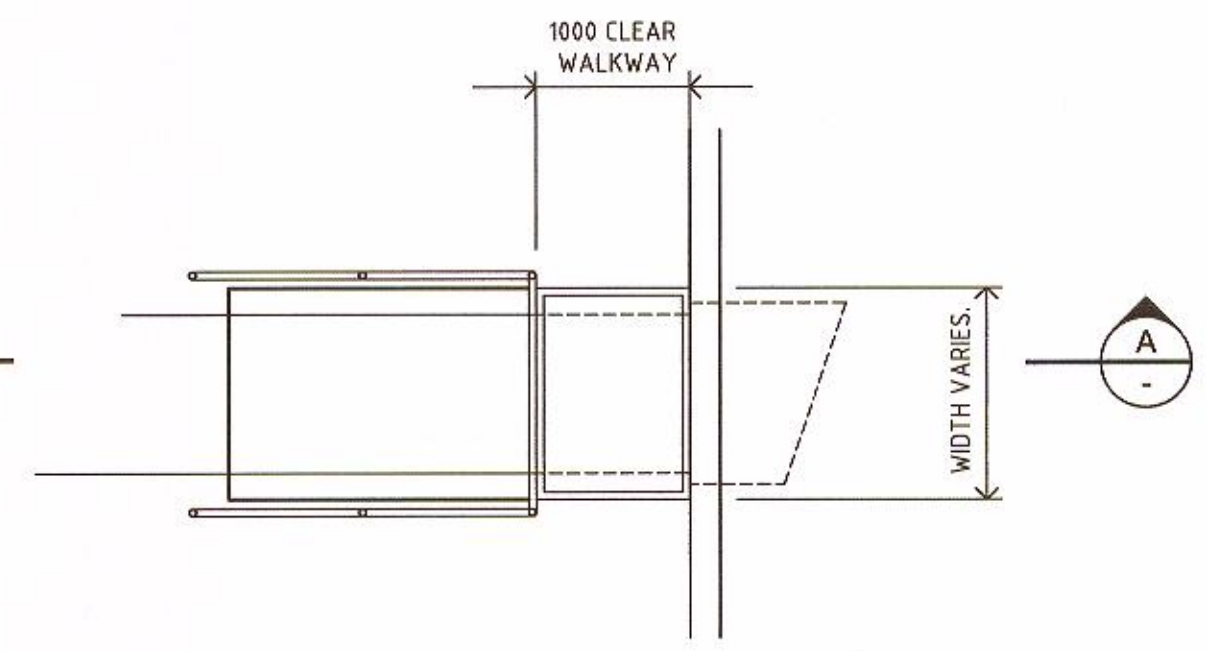


CABLE RAMP PLAN

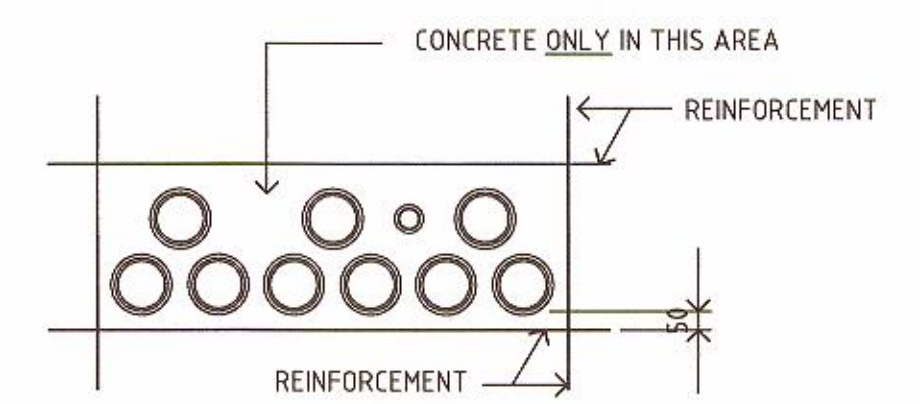

TYPICAL WALL CONDUIT PENETRATION WITHIN THE BASEMENT WALL
SIMILAR AT TRANSFORMER CABLE PITS
SCALE 1:20


NOTE:
- NO REINFORCEMENT SHALL BE INSTALLED BETWEEN INDIVIDUAL CONDUITS

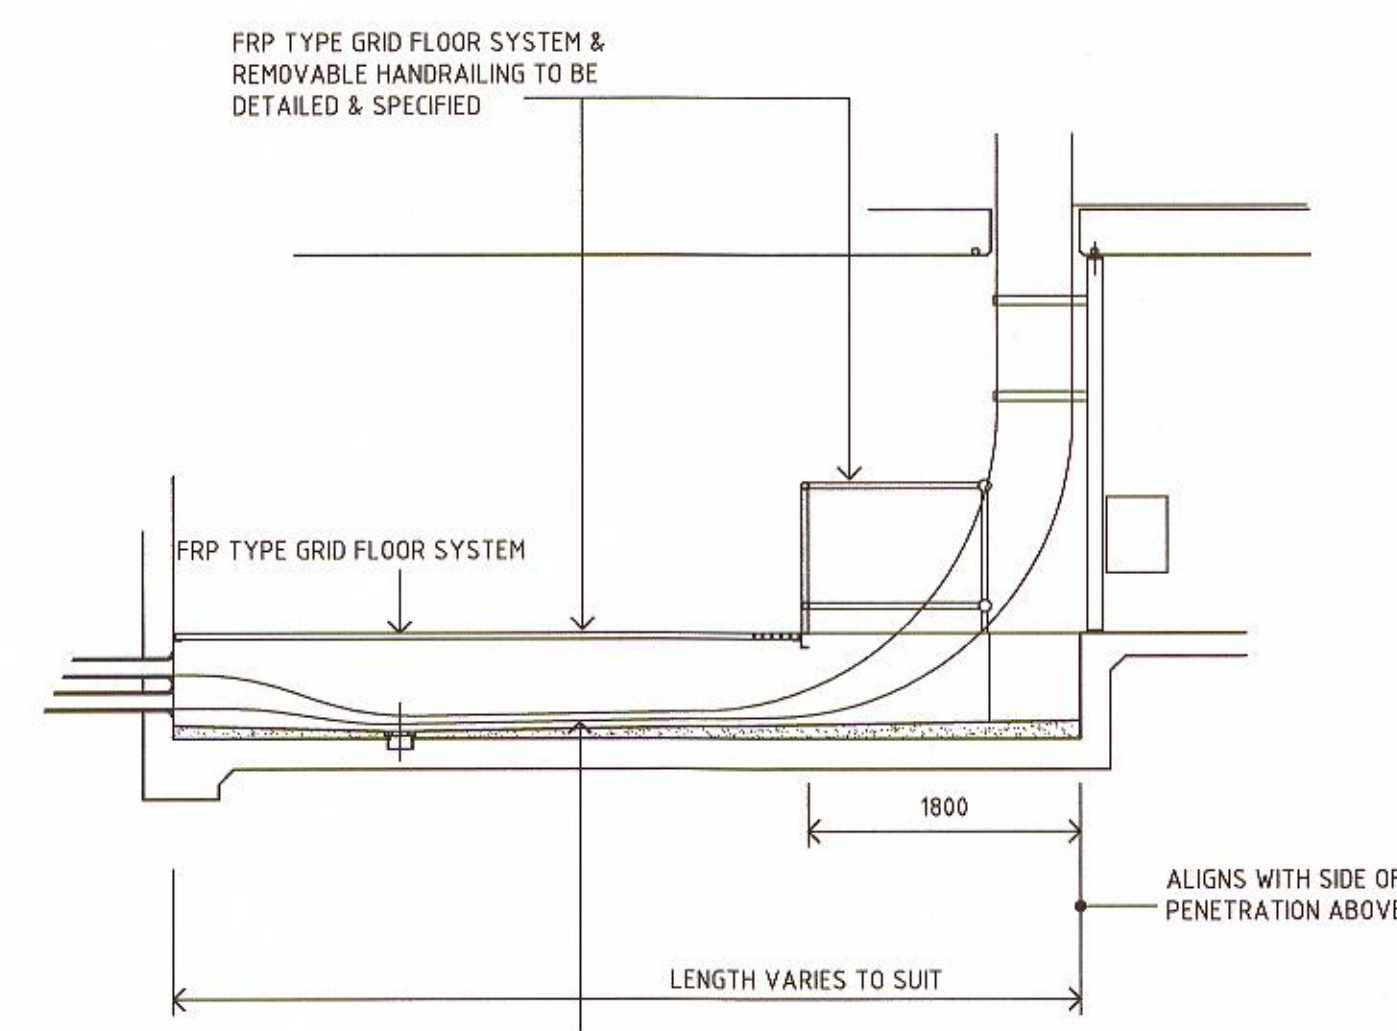


SECTION B

ALL CABLE TRENCHES TO INCORPORATE A GRATED TRENCH DRAIN WITH ADJACENT SURFACES TOPPED WITH A MINIMUM FALL OF 1 IN 200 THERETO.


NOTE:
TO THE EXPOSED SIDE SURFACES OF TRENCHES FILL ALL CREVICES & REMOVE DAGS & SHARP EDGES.

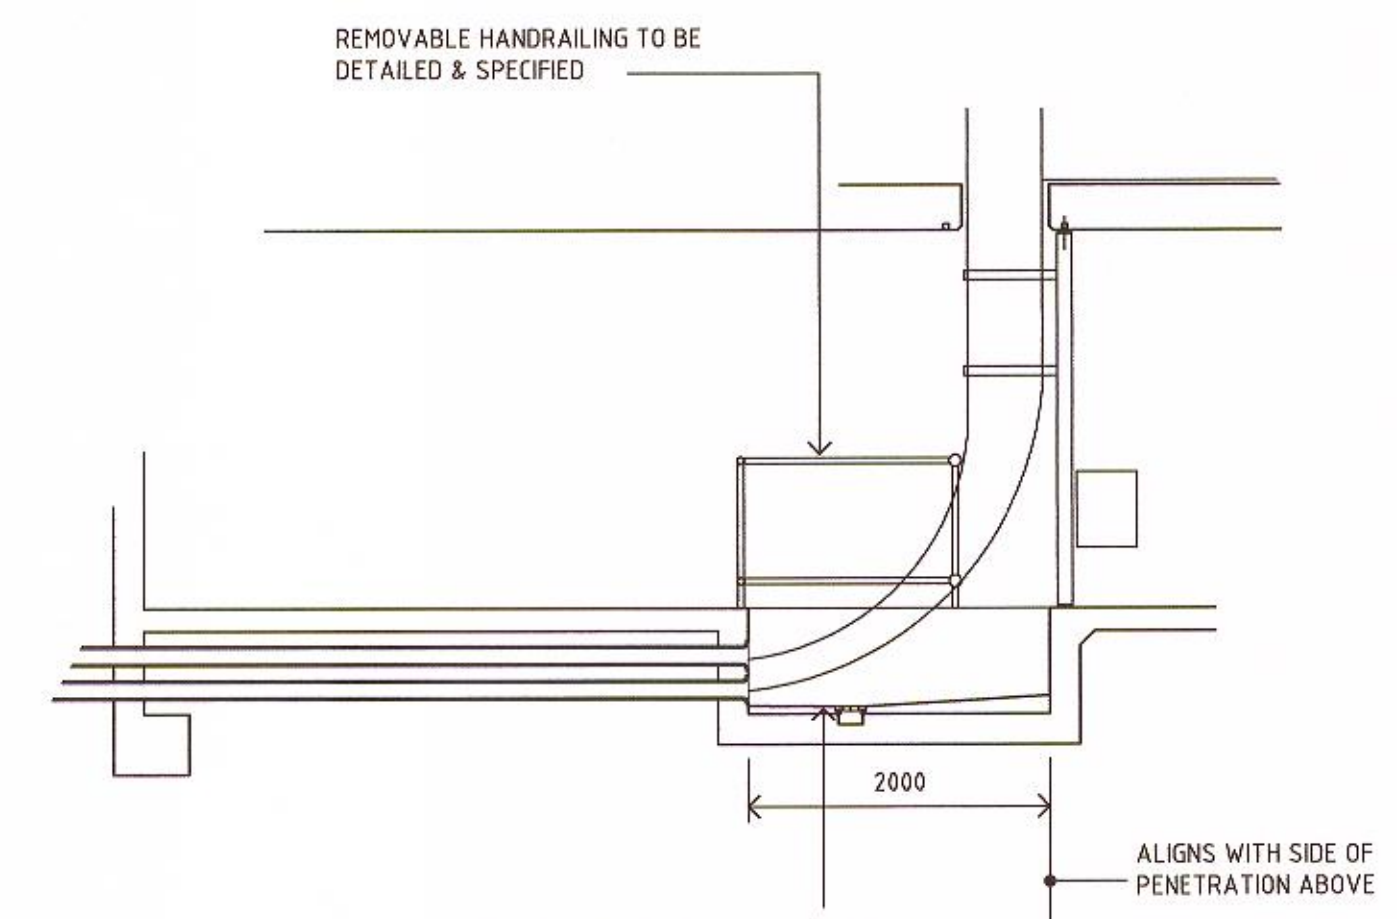

SECTION C

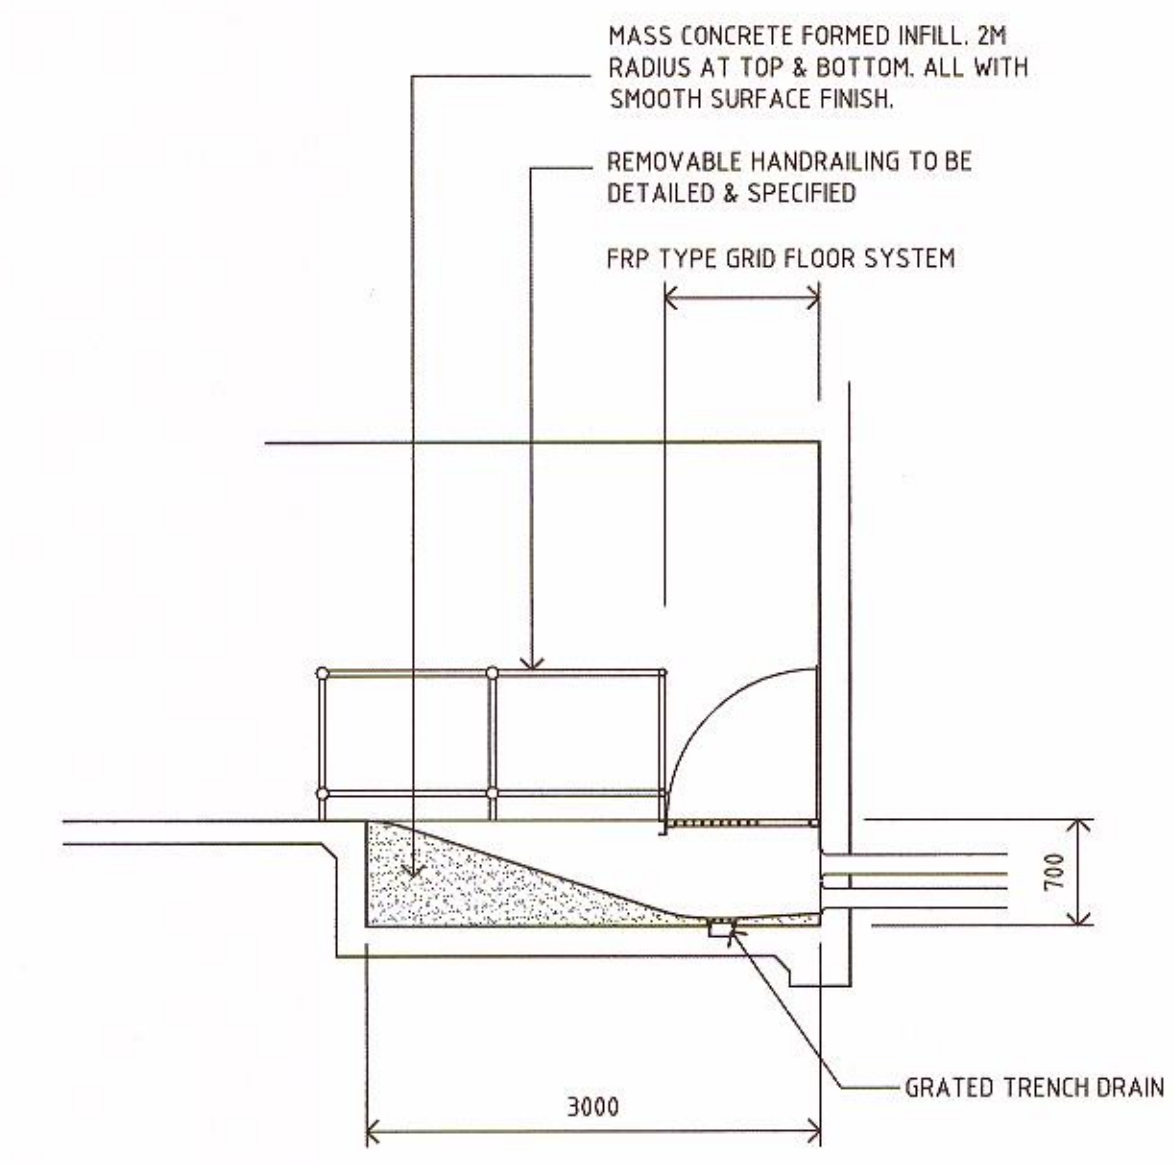

SECTION A

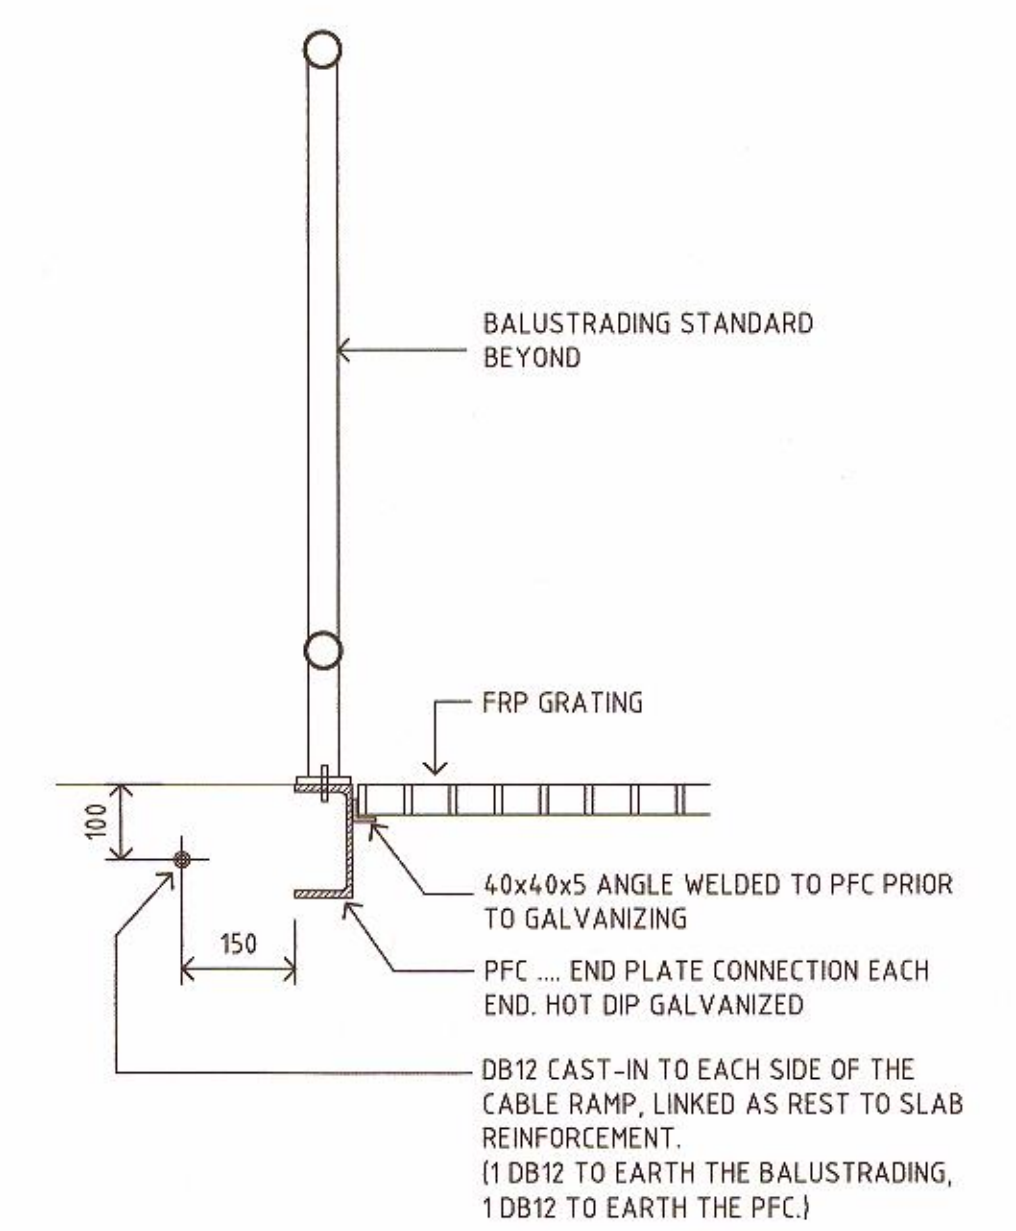

TYPICAL HAND RAIL AND FLOOR GRATING DETAIL
SCALE 1:10

AMENDMENTS
ORIGINAL
ISSUE
Job No.
A

	ORIGINAL SCALE 1:50	APPROVED
	DRAWN BM/IRM	CH'D CP
	DATE 27/09/2011	

Endeavour Energy

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

REFERENCE DRAWINGS

AUTHORISED

MGR TRANSMISSION PROJECT DEVELOPMENT

7-1/1, 1/2

Rev.

A1 366061 A

SHEET No 1 OF 1 SHEETS

STANDARD DETAILS FOR:
BASEMENT CABLE, RAMPS, PITS & TRENCHES AND
CONDUIT PENETRATIONS IN BASEMENT & CABLE WALLS